


### SIDE VIEW

Wall or any immovable object

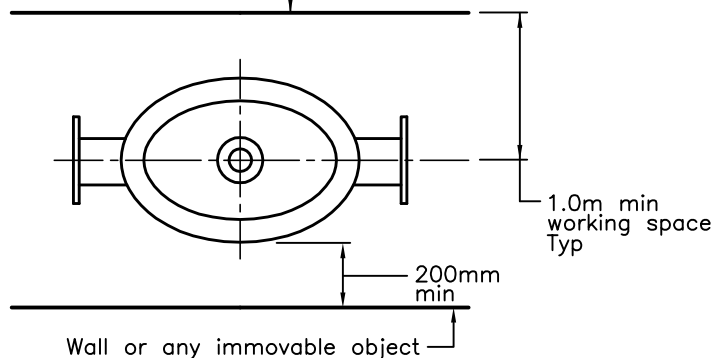

### NOTES:

### TOP VIEW OF METER

- A All joints shall be restrained. Pipes and valves shall be supported.
- B Flanged fittings are required for all compound meters.
- C By-pass line size shall be same size as the meter line.
- D Working space at the meter shall be a minimum of 2.0m in height.
- E Details of this OPSD shall be verified in conjunction with OBC where it governs.
- F All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING

Nov 2019

Rev 3

PIPING LAYOUT  
FOR WATER METERS  
IN BUILDING WITH BY-PASS



OPSD 1107.030