

**STORMWATER MANAGEMENT PLAN**

**McLEOD MEADOWS**

**CITY OF NIAGARA FALLS**

**Prepared by:**

**Upper Canada Consultants  
30 Hannover Drive, Unit 3  
St. Catharines, Ontario  
L2W 1A3**

**November 2024**

## **TABLE OF CONTENTS**

<b>1.0</b>	<b>INTRODUCTION</b>	<b>1</b>
1.1	Study Area	1
1.2	Objectives	1
1.3	Existing and Future Conditions	3
<b>2.0</b>	<b>STORMWATER MANAGEMENT CRITERIA</b>	<b>4</b>
<b>3.0</b>	<b>STORMWATER ANALYSIS</b>	<b>5</b>
3.1	Design Storms	5
3.1	Design Storms	5
3.3	Future Conditions	6
<b>4.0</b>	<b>STORMWATER MANAGEMENT ALTERNATIVES</b>	<b>10</b>
4.1	Screening of Stormwater Management Alternatives	10
4.2	Selection of Stormwater Management Alternatives	12
<b>5.0</b>	<b>STORMWATER MANAGEMENT PLAN</b>	<b>13</b>
5.1	Proposed Stormwater Management Facility	13
5.1.1	Stormwater Quality	13
5.1.2	Stormwater Quality Control	13
5.1.3	Stormwater Management Facility Configuration	13
<b>6.0</b>	<b>SEDIMENT AND EROSION CONTROL</b>	<b>18</b>
<b>7.0</b>	<b>STORMWATER MANAGEMENT FACILITY MAINTENANCE</b>	<b>19</b>
7.1	Wet Pond Facility	19
<b>8.0</b>	<b>CONCLUSIONS AND RECOMMENDATIONS</b>	<b>21</b>

**LIST OF TABLES**

Table 1.	Rainfall Data	5
Table 2.	Hydrologic Parameters	6
Table 3.	Peak Flow and Volume Comparisons	7
Table 4.	Evaluation of Stormwater Management Practices	11
Table 5.	Stormwater Quality Volume Requirements	13
Table 6.	Proposed Stormwater Management Facility Forebay Sizing	15
Table 7.	Characteristics of the Proposed Stormwater Management Facility	16
Table 8.	Impacts of SWM Facilities on Peak Flows at Outlet A	16

**LIST OF FIGURES**

Figure 1.	Site Location Plan	2
Figure 2.	Existing Drainage Areas	8
Figure 3.	Future Drainage Areas	9
Figure 4.	Proposed Stormwater Management Facility	17

**APPENDICES**

Appendix A	Stormwater Management Facility Calculations
Appendix B	MIDUSS Output Files

**REFERENCES**

1. Stormwater Management Planning and Design Manual  
Ontario Ministry of Environment and Energy (March 2003)
2. Stormwater Quality Best Management Practices  
Ontario Ministry of Environment and Energy (June 1991)
3. MTO Drainage Management Technical Guidelines  
Ontario Ministry of Transportation (November 1989)
4. Engineering Design Guidelines Manual  
City of Niagara Falls (Amended January 2012)

# **STORMWATER MANAGEMENT PLAN**

## **McLeod Meadows**

### **CITY OF NIAGARA FALLS**

#### **1.0 INTRODUCTION**

##### **1.1 Study Area**


The proposed development of McLeod Meadows is located in the western limits of the City of Niagara Falls. The subject lands are located on the property known municipally as 9304 McLeod Road and includes the adjacent property located immediately west that does not have a municipal address. As shown in Figure 1, Site Location Plan, the subject property is situated south of McLeod Road, east of Beechwood Road, and west of a recently constructed development known as Forestview Estates. There is a tributary to Thompson Creek that traverses along the east boundary of the subject lands and separates the subject lands from the neighboring property (Forestview Estates) to the east.

The approximately 22.92ha property will include associated asphalt roads, concrete curb, catch basins, storm sewers, sanitary sewers and watermain. The stormwater drainage areas evaluated in this Stormwater Management Plan consist primarily of the subject lands and an external area located north of the subject lands. All existing and future stormwater flows from the site outlet to Thompson Creek.

##### **1.2 Objectives**

The objectives of this study are as follows:

1. Establish specific criteria for the management of stormwater from this site.
2. Determine the impact of this development on the peak flows of from this site.
3. Investigate alternatives for controlling the quantity and quality of stormwater from this site.
4. Establish land requirements as part of the Draft Plan of Subdivision application for the subject lands.

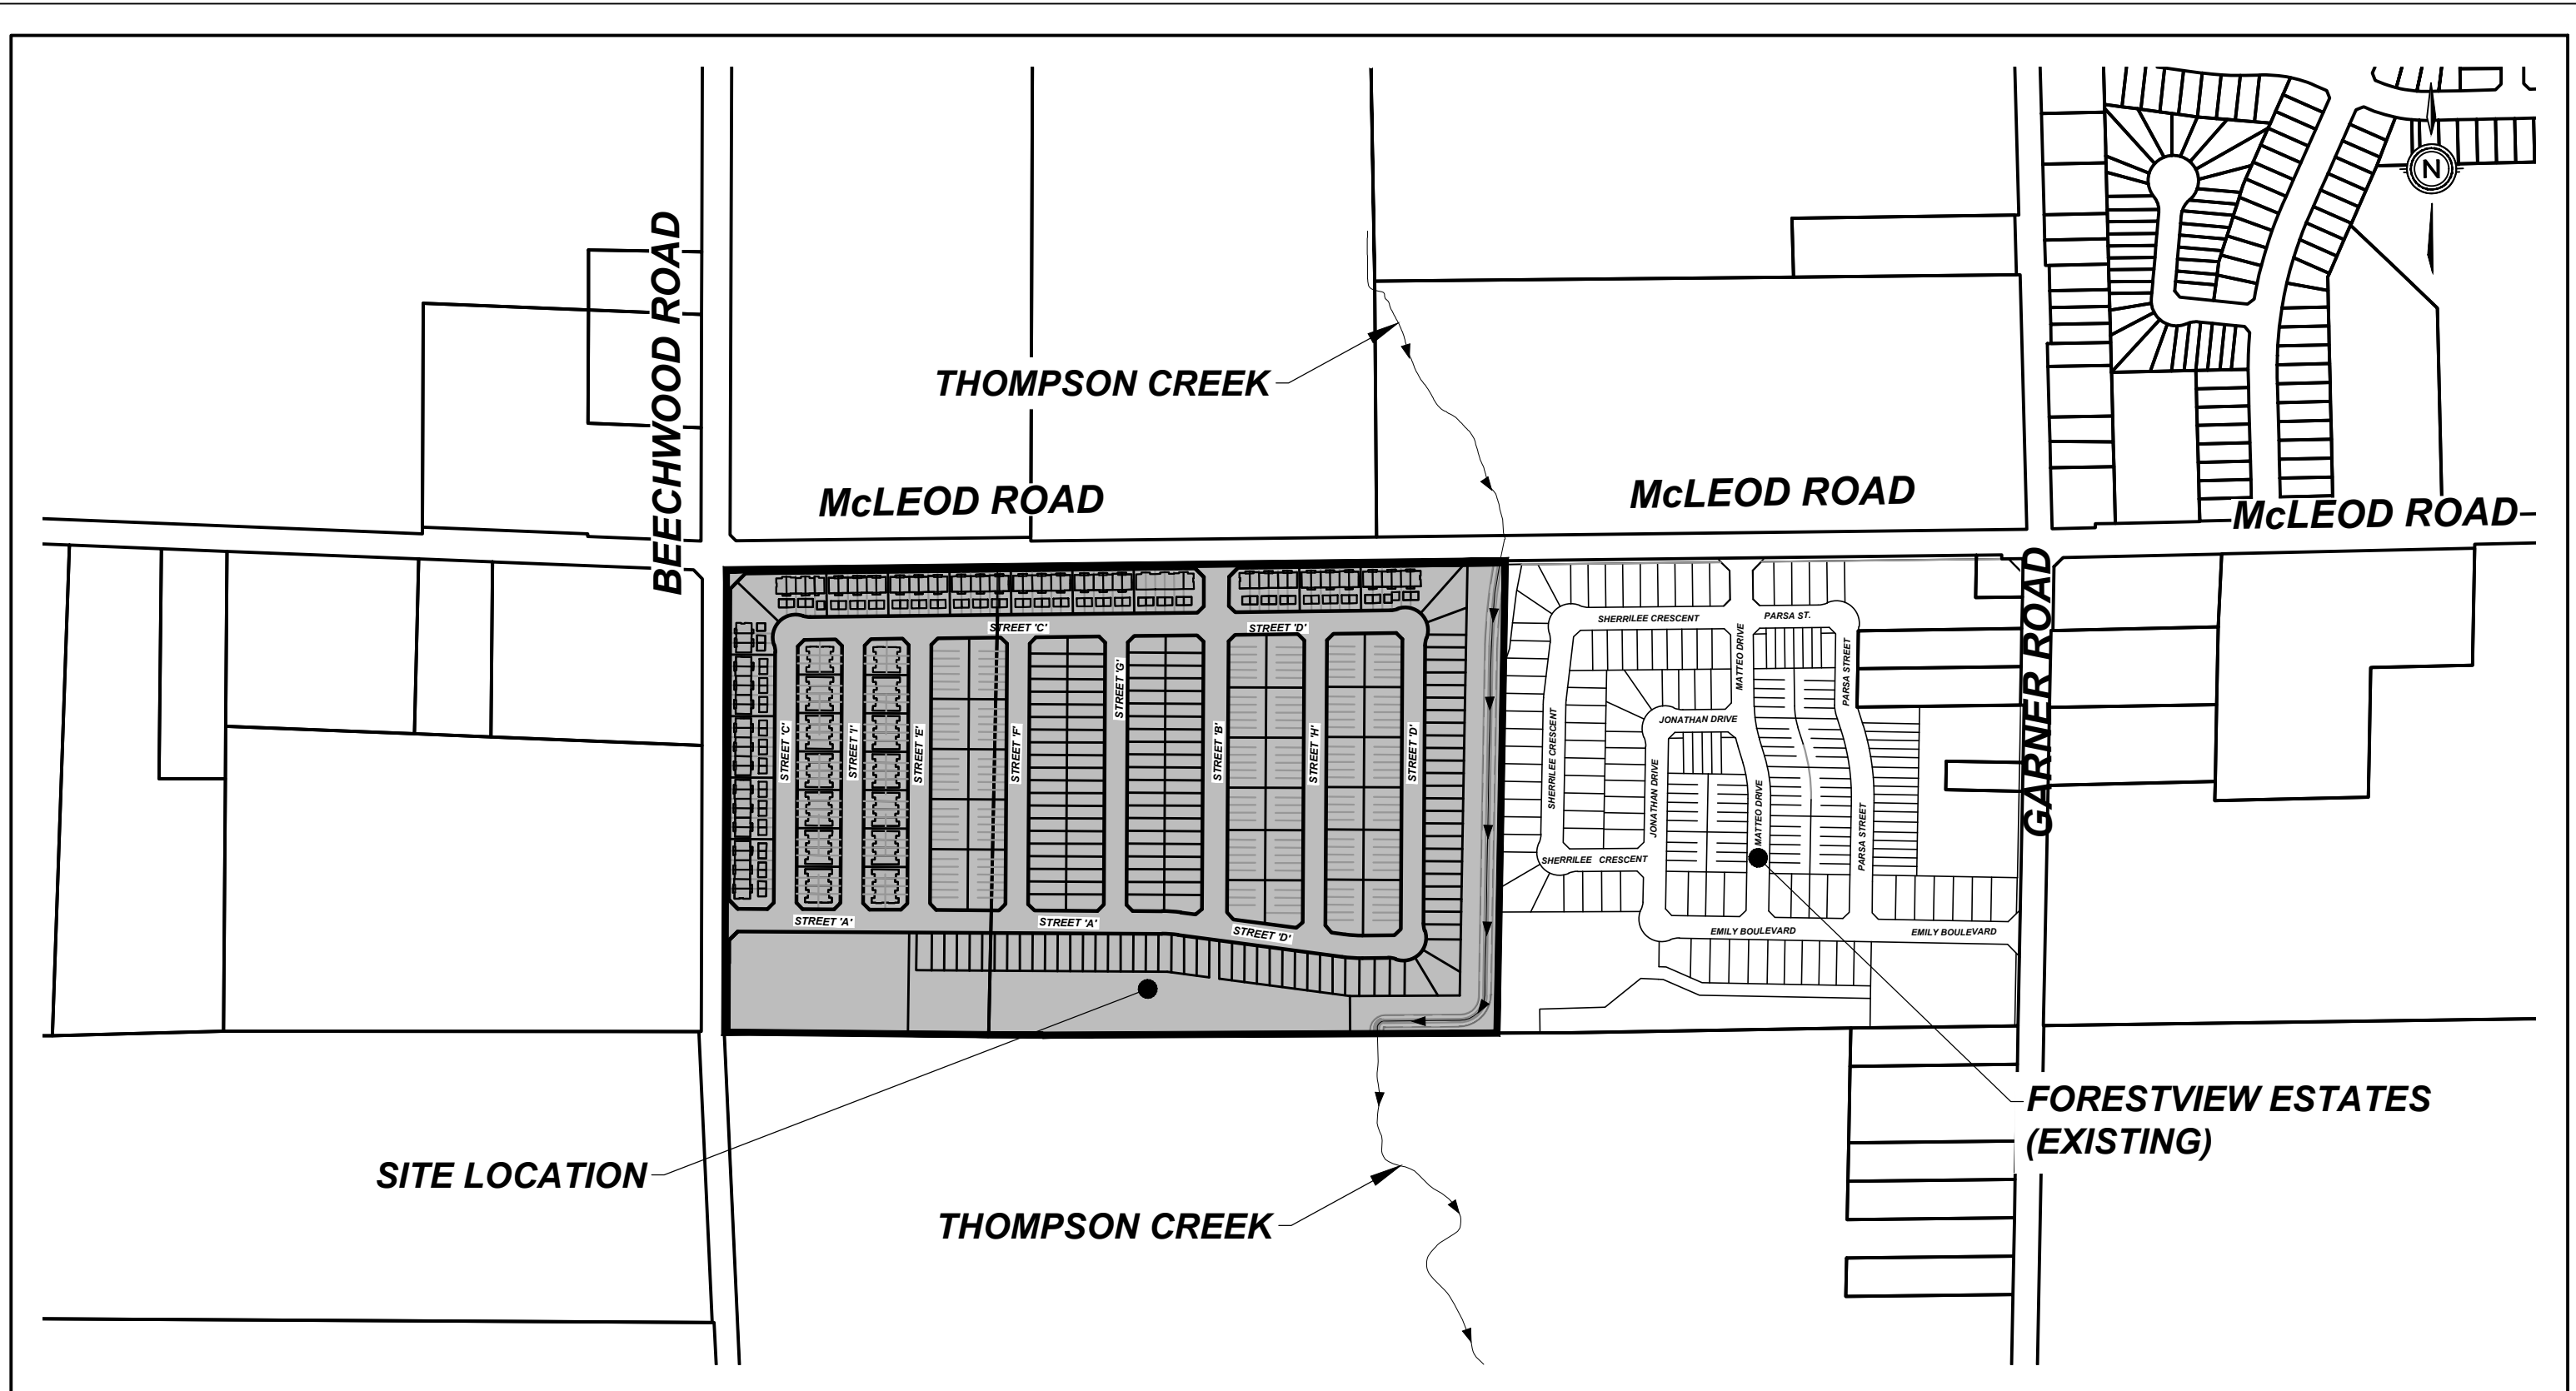

**McLEOD MEADOWS  
SITE LOCATION  
CITY OF NIAGARA FALLS**

DATE	2024-11-04
SCALE	1:5000 m
REF No.	2054
DWG No.	FIGURE 1

### **1.3 Existing and Future Conditions**

#### a) Existing Conditions

The site is presently vacant agricultural lands and historically contained a single residential family dwelling that has been demolished. The topography of the site conveys flows overland from north to south with three drainage outlets located at the southern portion of the property. Flows from the three drainage outlets ultimately converge and convey flows overland to Thompson Creek.

The native soils in the development areas of the subject lands consist mainly of lacustrine heavy clays. This soil type in the development and valley areas are classified as imperfectly drained and variably drained, respectively. This soil is classified in the Soil Conservation Service (SCS) classification method as belonging to hydrologic soil group C.

#### b) Future Conditions

This stormwater management plan will consider the proposed development under fully developed conditions. The proposed 22.92 hectare development shall consist of approximately 149 single family lots, 201 street town units, 108 back to back town units and 86 reverse frontage street towns. An existing reach of Thompson Creek is located along the east boundary of the subject lands. The proposed development will be provided with full urban services including sanitary and storm sewers, watermains, and asphalt roads with concrete curb and gutters.

## **2.0 STORMWATER MANAGEMENT CRITERIA**

New developments are required to provide stormwater management in accordance with provincial and municipal policies including:

- Stormwater Quality Guidelines for New Development (MECP/MNR, May 1991)
- Stormwater Management Planning and Design Manual (MECP, March 2003)

The site currently outlets to three different outlets located on the southern boundary of the subject property, which convey flows south to Thompson Creek and ultimately the Welland River. The Welland River is classified as a Type 1 fish habitat where Thompson Creek outlets. Based on this fish habitat, the corresponding MECP Level of Protection for stormwater management quality practices is Enhanced.

Based on the above policies and site specific considerations, the following stormwater management criteria have been established for this site.

- a. Stormwater **quality** controls are to be provided for the more frequent storm events to provide Enhanced Protection in accordance with MECP guidelines.
- b. Stormwater **quantity** controls are to be provided as follows:
  - i. Erosion controls to be provided in accordance with MECP guidelines. The guidelines require the storm runoff from a 25mm rainfall event to be detained for 24 hours.
  - ii. Quantity controls will be provided to control future site peak flows to existing levels at the existing outlet for various storm events up to the 100 year design storm event.



### 3.0 STORMWATER ANALYSIS

Stormwater flows and volumes for the existing and future conditions were estimated using the MIDUSS computer modelling program. This program was selected because it is applicable to an urban drainage area like the study area. This program is relatively easy to use and modify for the future drainage conditions and control facilities, and it readily allows for the use of design storm hyetographs for the various return periods being investigated.

#### 3.1 Design Storms

Design storm hyetographs were developed using a 4 hour Chicago distribution based on the City of Niagara Falls Intensity-Duration Frequency (IDF) Curves. The 25mm rainfall data is a generic design storm for the purpose of generating 25mm of rainfall over a 4 hour Chicago distribution. Table 1 summarizes the rainfall data.

<b>Table 1. Rainfall Data</b>				
<b>Design Storm (Return Period)</b>	<b>Distribution Parameters</b>			<b>Duration (minutes)</b>
	<b>Chicago Design Storm Parameters</b>			
	<b>a</b>	<b>b</b>	<b>c</b>	
25mm	512.00	6.00	0.800	240
5 Year	719.50	6.34	0.769	240
100 Year	1264.60	7.72	0.781	240

#### Existing Conditions

The existing conditions were modelled to establish the stormwater peak flows and volumes prior to any development in this subwatershed. The existing stormwater drainage areas for this site are shown on Figure 2. There is an external drainage area EX1 located north of the subject lands which is comprised primarily of farm land that conveys flows overland southerly to the existing roadside ditches on McLeod Road. Flows from drainage area EX1 combine with the flows from Drainage Area A1 and flow through Thompson Creek to the southeastern limit of the site (Outlet A). Existing drainage area B1 flows through a series of local drainage ditches within the subject lands and outlets through a central ditch at the southern portion of the site (Outlet B). Existing Drainage Area C1 outlets to the existing road side ditch on the east side of Beechwood Road (Outlet C). Flows from all three outlets ultimately converge at Brown Road and continue to flow southerly as part of the Thompson Creek watercourse. Input parameters for the computer model for the existing conditions are shown in Table 2. Table 3 shows the stormwater peak flows and volumes generated by the various design storm events.

**Proposed Conditions**

It is proposed to convey overland stormwater flows from the proposed development to the existing ditch at the southern limits of the property and ultimately outlet to Outlet A. The proposed drainage areas for the development shown in Figure 3, were modelled to establish the stormwater peak flows and volumes once development has been completed.


External Drainage EX1 will continue to flow through Thompson Creek along the eastern limits of the subject lands. Flows from Drainage Area A10 will drain to Thompson Creek uncontrolled and will combine with the flows from the External Drainage Area EX1. Drainage Area A11 represents a majority of the proposed development. A conservatively assumed imperviousness value of 60% has been assumed for the future residential development. Drainage Area A11 will flow through the internal storm sewer system and outlet to the proposed Stormwater Management Facility (SWMF) (Block 215) located at the southern limits of the subject lands. Drainage Area A12 represents the proposed park block and SWMF block. Flows from Drainage Area A11 and A12 will combine with the flows from Drainage Areas EX1 and A10 and outlet at Outlet A. Drainage Area C10 represents flows from the proposed development that will continue to outlet to Beechwood Road uncontrolled (Outlet C).

Input parameters for the computer model for proposed development conditions are shown in Table 2. The results of this modelling are shown in Table 3 for the various design storm events.

<b>Table 2. Hydrologic Parameters</b>					
<b>Subcatchment No.</b>	<b>Area (ha)</b>	<b>Length (m)</b>	<b>Slope (%)</b>	<b>Impervious (%)</b>	<b>SCS CN</b>
<b>Existing Conditions</b>					
EX1	54.29	605.0	1.0	3.0	74
A1	15.89	325.5	1.0	1.5	74
B1	5.72	195.3	1.0	1.0	74
C1	2.29	123.6	1.0	4.4	74
<b>78.19</b>		<b>Total Area</b>			
<b>Future Conditions</b>					
EX1	55.61	610.0	1.0	4.0	74
A10	2.46	130.0	1.0	10.0	74
A11	16.32	330.0	1.0	60.0	74
A12	2.96	140.0	1.0	10.0	74
C10	0.84	123.6	1.0	18.0	74
<b>78.19</b>		<b>Total Area</b>			

<b>Table 3. Peak Flow and Volume Comparisons</b>						
<b>Design Storm</b>	<b>Peak Flow (m<sup>3</sup>/s)</b>			<b>Volume (m<sup>3</sup>)</b>		
	<b>Existing</b>	<b>Future</b>	<b>Change</b>	<b>Existing</b>	<b>Future</b>	<b>Change</b>
<b>Outlet A</b>						
5 Year	0.356	1.947	+447%	6690	10246	+3556
100 Year	1.378	3.499	+154%	17359	23235	+5876
<b>Outlet B</b>						
5 Year	0.047	0	-100%	519	0	-519
100 Year	0.182	0	-100%	1377	0	-1377
<b>Outlet C</b>						
5 Year	0.024	0.024	+0%	228	114	-114
100 Year	0.091	0.046	-49%	581	257	-324

As seen in Table 3, the future stormwater flows at Outlet B will be directed to Outlet A. Therefore, there will be no future stormwater flows from the proposed development outletting to Outlet B. However, there will be increased stormwater flows at Outlet A. As shown in Table 3, the future peak flows to Outlet A are increased above existing levels in the 5 and 100 year design storm event. Therefore, stormwater management quantity controls are required for the future stormwater flows discharging from the site to Outlet A. Future peak flows to Outlet C are reduced below existing levels and does not require quantity controls. The detailed MIDUSS modelling output files have been enclosed in Appendix B for reference.

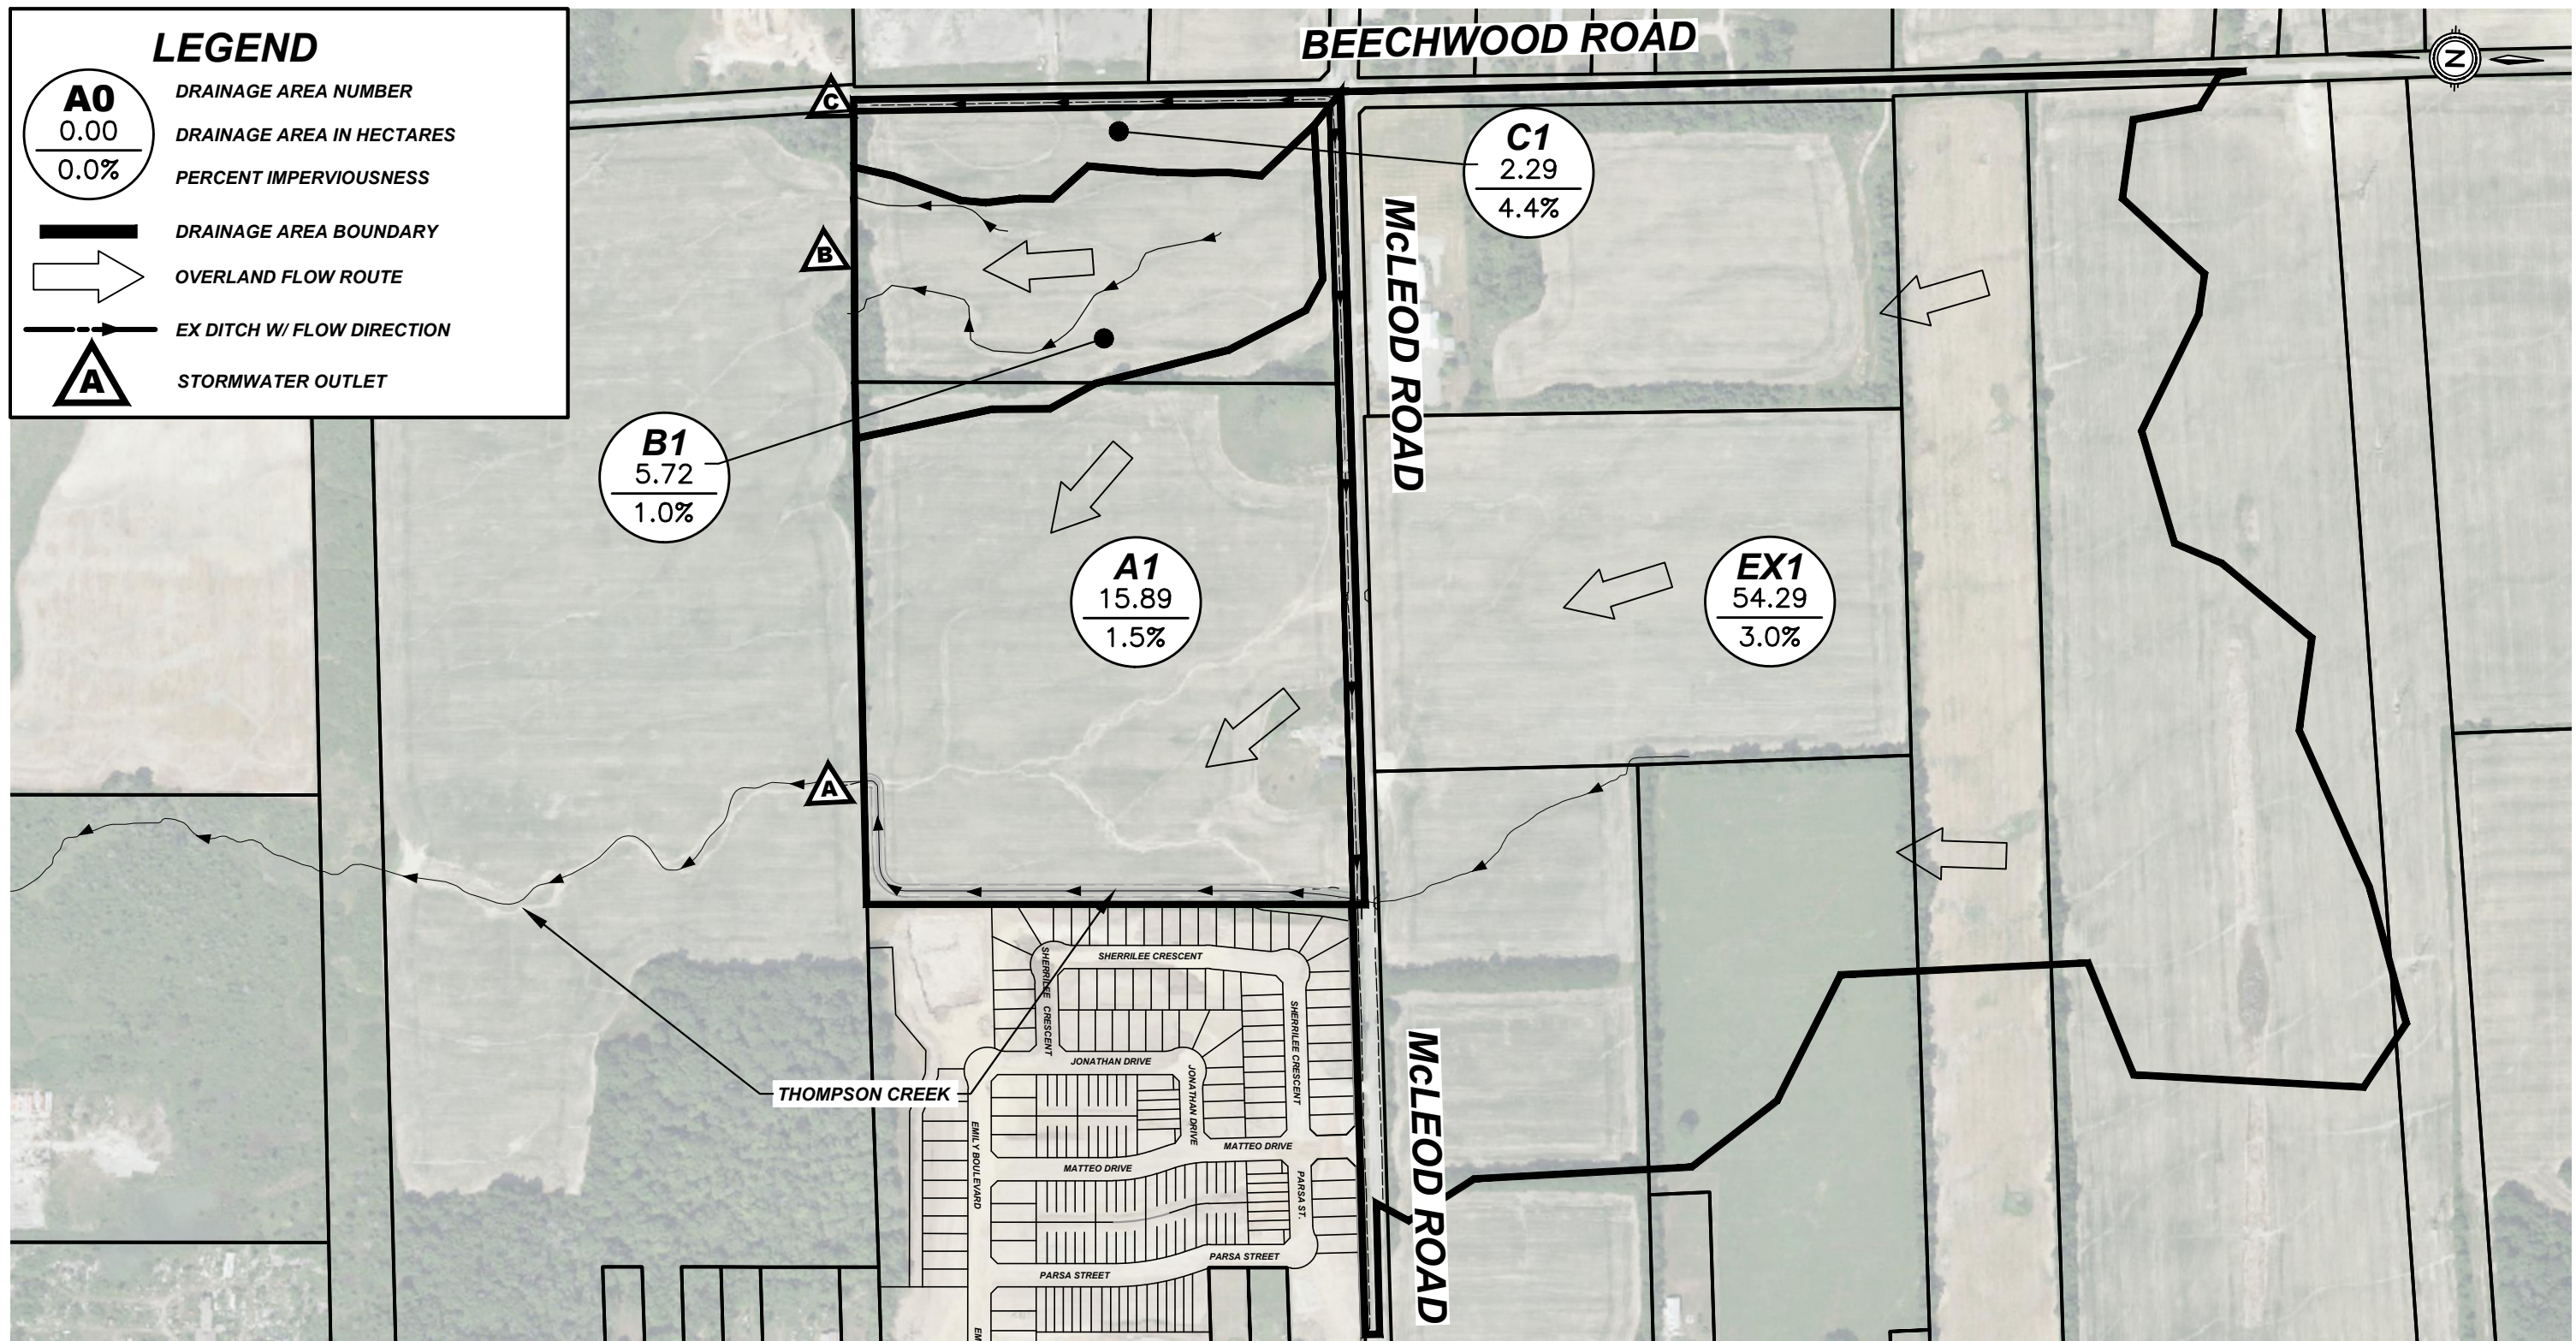

**UPPER CANADA  
CONSULTANTS**  
ENGINEERS / PLANNERS


**McLEOD MEADOWS  
EXISTING STORM DRAINAGE AREAS  
CITY OF NIAGARA FALLS**

DATE	2024-11-04
SCALE	1:5000 m
REF No.	2054
DWG No.	FIGURE 2



**LEGEND**

- A0**  
0.00  
0.0%
- DRAINAGE AREA NUMBER**
- DRAINAGE AREA IN HECTARES**
- PERCENT IMPERVIOUSNESS**
- DRAINAGE AREA BOUNDARY**
- EXISTING OVERLAND FLOW ROUTE**
- STORMWATER OUTLET**

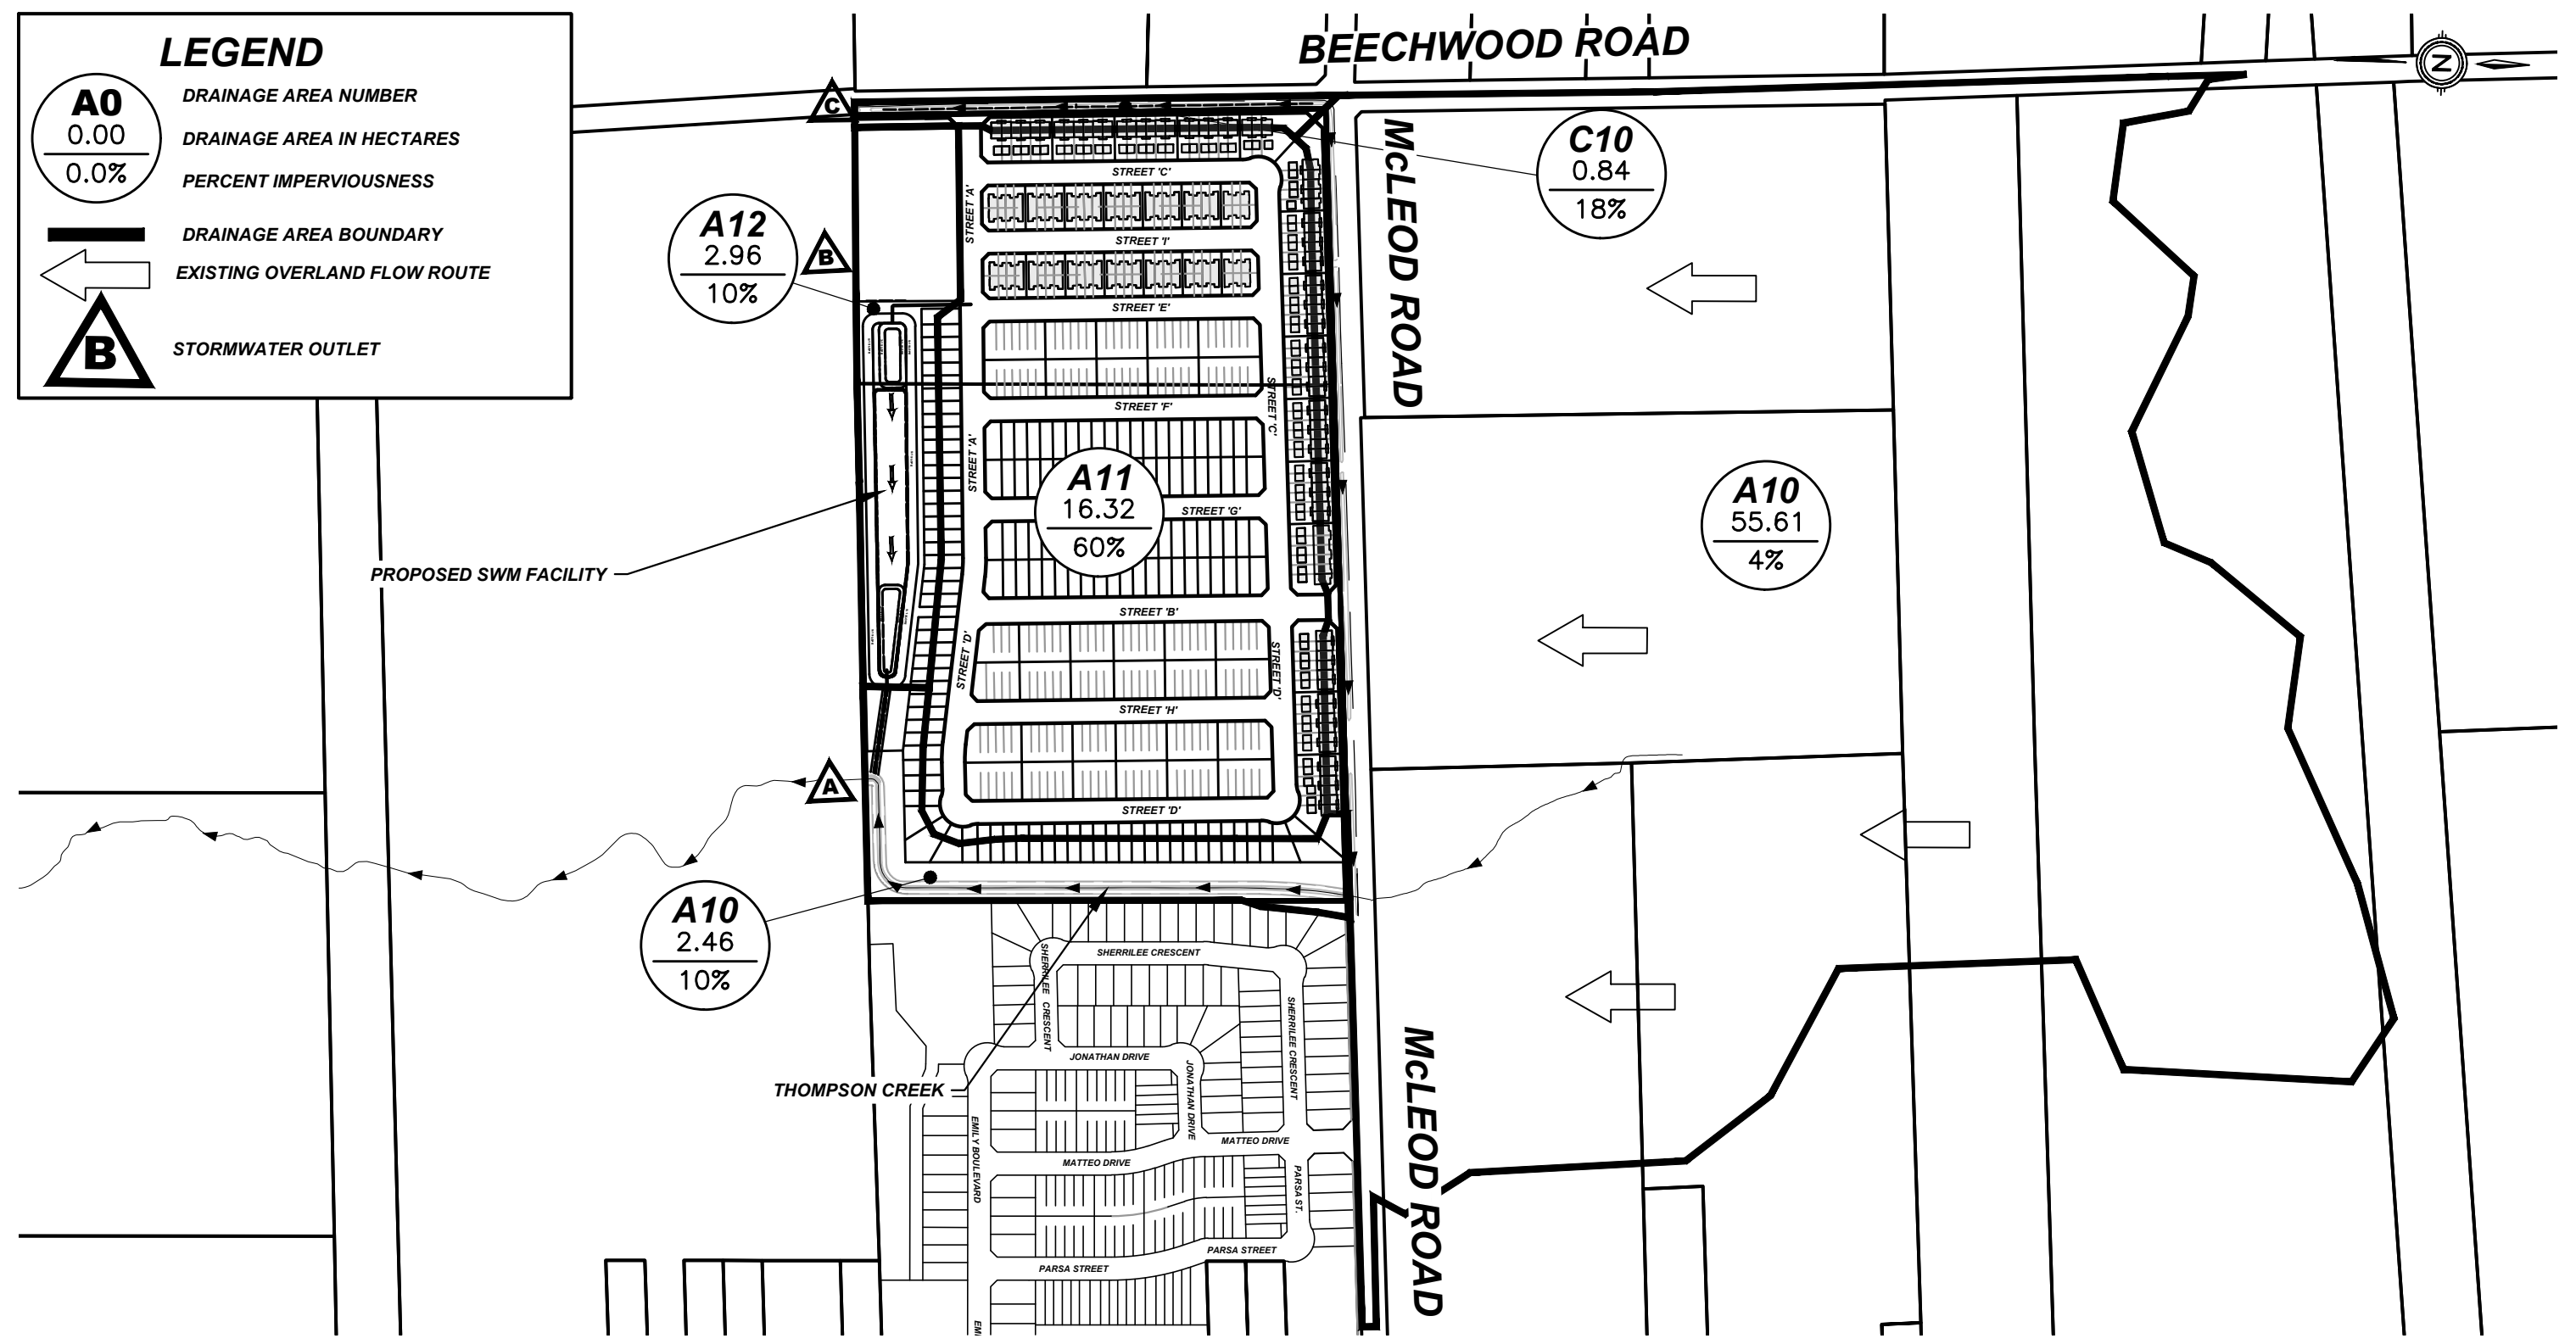

**McLEOD MEADOWS  
PROPOSED STORM DRAINAGE AREAS  
CITY OF NIAGARA FALLS**

DATE	2024-11-04
SCALE	1:5000 m
REF No.	2054
DWG No.	FIGURE 3

## **4.0 STORMWATER MANAGEMENT ALTERNATIVES**

### **4.1 Screening of Stormwater Management Alternatives**

A variety of stormwater management alternatives are available to control the quality of stormwater, most of which are described in the Stormwater Management Planning and Design Manual (MECP, March 2003). Alternatives for the proposed and ultimate developments were considered in the following broad categories: lot level, vegetative, infiltration, and end-of-pipe controls. General comments on each category are provided below. Individual alternatives for the proposed development are listed in Table 4 with comments on their effectiveness and applicability to the proposed outlet.

#### a) Lot Level Controls

Lot level controls are not generally suitable as the primary control facility for quality control. They are generally used to enhance stormwater quality in conjunction with other types of control facilities.

#### b) Vegetative Alternatives

Vegetative stormwater management practices are not generally suitable as the primary control facility for quality control. They are generally used to enhance stormwater quality in conjunction with other types of control facilities.

#### c) Infiltration Alternatives

Where soils are suitable, infiltration techniques can be very effective in providing quantity and quality control. However, the very small amount of surface area on this site dedicated to permeable surfaces such as greenspace and landscaping make this an impractical option. Therefore, infiltration techniques will not be considered for this development.

#### d) End-of-Pipe Alternatives

Surface storage techniques can be very effective in providing quality and quantity control. Dry facilities are effective practices for stormwater erosion and flood control for large drainage areas.

Wet facilities are effective practices for stormwater erosion, quality and quantity control for large drainage areas.

**Table 4. Evaluation of Stormwater Management Practices**

McLeod Meadows	Criteria for Implementation of Stormwater Management Practices (SWMP)					Technical Effectiveness (10 high)	Recommend Implementation Yes / No	Comments
	Topography	Soils	Bedrock	Groundwater	Area			
Site Conditions	Variable 1 to 3%	Silty Sand ±13.3mm/hr	At Considerable Depth	At Considerable Depth	± 19.28ha			
<b>Lot Level Controls</b>								
Lot Grading	<5%	nlc	nlc	nlc	nlc	2	Yes	Quality/quantity benefits
Roof Leaders to Surface	nlc	nlc	nlc	nlc	nlc	2	Yes	Quality/quantity benefits
Roof Ldrs.to Soakaway Pits	nlc	loam, infiltr. > 15 mm/hr	>1m Below Bottom	>1m Below Bottom	< 0.5 ha	6	No	Unsuitable site conditions
Sump Pump Fdtn. Drains	nlc	nlc	nlc	nlc	nlc	2	No	Unsuitable site conditions
<b>Vegetative</b>								
Grassed Swales	< 5 %	nlc	nlc	nlc	nlc	7	Yes	Quality/quantity benefits
Filter Strips(Veg. Buffer)	< 10 %	nlc	nlc	>.5m Below Bottom	< 2 ha	5	No	Unsuitable site conditions
<b>Infiltration</b>								
Infiltration Basins	nlc	loam, infiltr. > 15 mm/hr	>1m Below Bottom	>1m Below Bottom	< 5 ha	2	No	Unsuitable site conditions
Infiltration Trench	nlc	loam, infiltr. > 15 mm/hr	>1m Below Bottom	>1m Below Bottom	< 2 ha	4	No	Unsuitable site conditions
Rear Yard Infiltration	< 2.0 %	loam, infiltr. > 15 mm/hr	>1m Below Bottom	>1m Below Bottom	< 0.5 ha	7	No	Unsuitable site conditions
Perforated Pipes	nlc	loam, infiltr. > 15 mm/hr	>1m Below Bottom	>1m Below Bottom	nlc	4	No	Unsuitable site conditions
Pervious Catch basins	nlc	loam, infiltr. > 15 mm/hr	>1m Below Bottom	>1m Below Bottom	nlc	3	No	Unsuitable site conditions
Sand Filters	nlc	nlc	nlc	>.5m Below Bottom	< 5 ha	5	No	High maintenance/poor aesthetics
<b>Surface Storage</b>								
Dry Ponds	nlc	nlc	nlc	nlc	> 5 ha	7	No	No quality control
Wet Ponds	nlc	nlc	nlc	nlc	> 5 ha	9	No	Very effective quality control
Wetlands	nlc	nlc	nlc	nlc	> 5 ha	9	Yes	Very effective quality control
<b>Other</b>								
Oil/Grit Separator	nlc	nlc	nlc	nlc	<2 ha	3	No	Limited benefit/area too large

Reference: Stormwater Management Practices Planning and Design Manual - 1994  
 nlc - No Limiting Criteria

## **4.2 Selection of Stormwater Management Alternatives**

Stormwater management alternatives were screened based on technical effectiveness, physical suitability for this site, and their ability to meet the stormwater management criteria established for proposed and future development areas. The following stormwater management alternatives are recommended for implementation on the proposed development:

- **Lot grading** to be kept as flat as practical in order to slow down stormwater and encourage infiltration.
- **Roof leaders to be discharged to the ground surface** in order to slow down stormwater and encourage infiltration.
- **Grassed swales** to be used to collect rear lot drainage. Grassed swales tend to filter sediments and slow down the rate of stormwater.
- A **wetland facility** is proposed to be constructed to provide stormwater quality enhancement for frequent storms and quantity controls up to and including the 100 year design storm event.



**5.0 STORMWATER MANAGEMENT PLAN**

**5.1 Proposed Stormwater Management Facility**

**5.1.1 Stormwater Quality**

The stormwater drainage outlet for the proposed development is Thompson Creek and ultimately the Welland River which has been identified by the Ministry of Natural Resources watercourse evaluation as Type 1 fish habitat. Therefore, the minimum level of protection from the subjects lands is Enhanced protection (80% TSS Removal).

Based on Table 3.2 of SWMP & Design Manual, the water quality storage requirement is approximately 101m<sup>3</sup>/ha for wetland facilities providing *Enhanced* protection for developments with 52% impervious areas. The drainage area requiring stormwater quality improvement draining to the proposed facility is 19.28 hectares. The storage volumes required for this proposed facility are shown in Table 5.

<b>Table 5. Stormwater Quality Volume Calculations</b>	
<p><b>Total Water Quality Volume</b>                      = 19.28 ha x 101 m<sup>3</sup>/ha                      = 1947 m<sup>3</sup></p>	<p>Reference: Table 3.2, SWMP &amp; Design Manual                      (MECP 2003)</p>
<p><b>Permanent Pool Volume</b>                      = 19.28 ha x 61 m<sup>3</sup>/ha                      = 1176 m<sup>3</sup></p>	<p><b>Extended Detention Volume</b>                      = 19.28 ha x 40 m<sup>3</sup>/ha                      = 771 m<sup>3</sup></p>

**5.1.2 Stormwater Quantity Control**

As shown in the previous Table 3, stormwater management quantity controls are required to reduce future peak flows from the development area to existing levels up to and including the 100-year design storm event. The stormwater peak flows from the proposed development shall be reduced to the existing levels by providing stormwater quantity storage. It is proposed to construct a control structure outlet to reduce the peak stormwater flows outletting from the proposed wetland facility.

**5.1.3 Stormwater Management Facility Configuration**

It is proposed to construct a two-stage outlet to provide the required stormwater quantity controls. The first stage of control consists of a reverse slope pipe acting as an orifice to control future stormwater flows generated from frequent storm events. The second stage of control consists of an outlet weir which provides an outlet for flows exceeding the required extended detention volume. An emergency spillway will provide an outlet for major storm events.

The top of the permanent pool is at an elevation of 179.50m and the bottom of the permanent pool is at an elevation of 179.20m for a depth of 0.3m. At the proposed outlet, a 1.0m deep pool is also provided (Bottom of the deep pool is 178.20m). The area of the deep pool is 1,100m<sup>2</sup>, which is 22% of the total permanent pool area (5,053m<sup>2</sup>) and less than the maximum permissible area of 25%. The configuration of the facility provides 2,313m<sup>3</sup> of permanent pool volume, which is more than the required 1,176m<sup>3</sup>. The proposed top of pond is at an elevation of 181.00m, providing a total active storage volume of 12,977m<sup>3</sup>.

Based on the proposed configuration of the proposed facility, it was determined that a 100mm diameter reverse slope pipe, functioning as an orifice with an invert of 179.50m within the ditch inlet, provides 92.2 hours of detention which is greater than the minimum 24 hours required in accordance with MECP guidelines. The ditch inlet catch basin will be located at an elevation of 180.80m and a 450mm diameter outlet pipe within the ditch inlet catch basin will have an invert of 179.50m and will outlet to Thompson Creek. An overflow spillway at an elevation of 180.85 will provide an outlet during extreme storm events. A stage-storage-discharge relationship was determined for the facility and is included in Appendix A.

Overland flows from the subject lands shall be directed to the proposed stormwater management facility through the proposed internal roadways. The preliminary foot print of the proposed wet pond facility is shown in Figure 4.

A sediment forebay was designed to minimize the transport of heavy sediment through the facility to Thompson Creek and to localize future maintenance activities. Calculations for the forebay sizing follow MECP Guidelines and are shown in Table 6.

**Table 6. Stormwater Management Facility Forebay Sizing**

a) Forebay Settling Length (MOE SWMP&D, Equation 4.5)

$$Settling\ Length = \sqrt{\left(\frac{r \times Q}{V_s}\right)}$$

r =	3.5	:1	(Length:Width Ratio)
Q <sub>p</sub> =	0.01	m <sup>3</sup> /s	(25mm Storm Pond Discharge)
V <sub>s</sub> =	0.0003	m/s	(Settling Velocity)

Settling Length = **10.87 m**

b) Dispersion Length (MOE SWMP&D, Equation 4.6)

$$Dispersion\ Length = \frac{8 \times Q}{D \times V_f}$$

Q =	1.601	m <sup>3</sup> /s	(5 Yr Stm Sew Design Inflow)
D =	1.50	m	(Depth of Forebay)
V <sub>f</sub> =	0.5	m/s	(Desired Velocity)

Dispersion Length = **17.08 m**

c) Minimum Forebay Deep Zone Bottom Width (MOE SWMP&D), Equation 4.7)

$$Width = \frac{Min.\ Forebay\ Length}{8}$$

**17.08 m** (minimum required length)

Width = **2.13 m** (minimum required width)

d) Average Velocity of Flow

$$Average\ Velocity = \frac{Q}{A}$$

Q =	0.907	m <sup>3</sup> /s	(25mm Storm Design Inflow)
A =	24.30	m <sup>2</sup>	(Cross Sectional Area)
D =	1.50	m	(Depth of Forebay)
W =	11.70	m	(Proposed Bottom Width)
SS =	3	:1	(Side Slopes - Minimum)

Average Velocity = **0.04 m/s**

Is this Acceptable? **Yes** (Maximum velocity of flow = 0.15 m/s)

c) Cleanout Frequency

Is this Acceptable?	<b>Yes</b>	L =	41.5	m	(Proposed Bottom Length)
		ASL =	1.7	m <sup>3</sup> /ha	(Annual Sediment Loading)
		A =	19.28	ha	(Drainage Area)
		FRC =	80	%	(Facility Removal Efficiency)
		FV =	1148.2	m <sup>3</sup>	(Forebay Volume)

Cleanout Frequency = **43.7 Years**

Is this Acceptable? **Yes** (10 Year Minimum Cleanout Frequency)


Table 7 summarizes the peak flows discharging to and from the proposed wet pond facility in the 5 and 100 year design storm event. As shown in the below table, the maximum wet pond elevation reaches 180.51m, with utilized active storage volume of 8,023 m<sup>3</sup> for the 100 year design storm event.

<b>Table 7. Stormwater Management Wet Pond Facility Characteristics</b>				
<b>Design Storm (Return Period)</b>	<b>Peak Flows (m<sup>3</sup>/s)</b>		<b>Maximum Elevation (m)</b>	<b>Maximum Volume (m<sup>3</sup>)</b>
	<b>Inflow</b>	<b>Outflow</b>		
5 Year	1.601	0.016	180.62	4,075
100 Year	2.677	0.022	180.51	8,023

<b>Table 8. Impacts of Wet Pond Facility on Future Peak Flows at Outlet A</b>			
<b>Design Storm</b>	<b>Peak Flow (m<sup>3</sup>/s)</b>		
	<b>Existing</b>	<b>Future with SWM</b>	<b>Change*</b>
5 Year	0.356	0.353	-0.8%
100 Year	1.378	1.091	-21%

**Note:** \*indicates the percent change between existing conditions and future conditions with stormwater management controls in place.

As shown in Table 8 above, the proposed stormwater management facility can provide adequate stormwater quantity controls to reduce future peak stormwater flows below existing levels to Outlet A up to and including the 100 year design storm event.

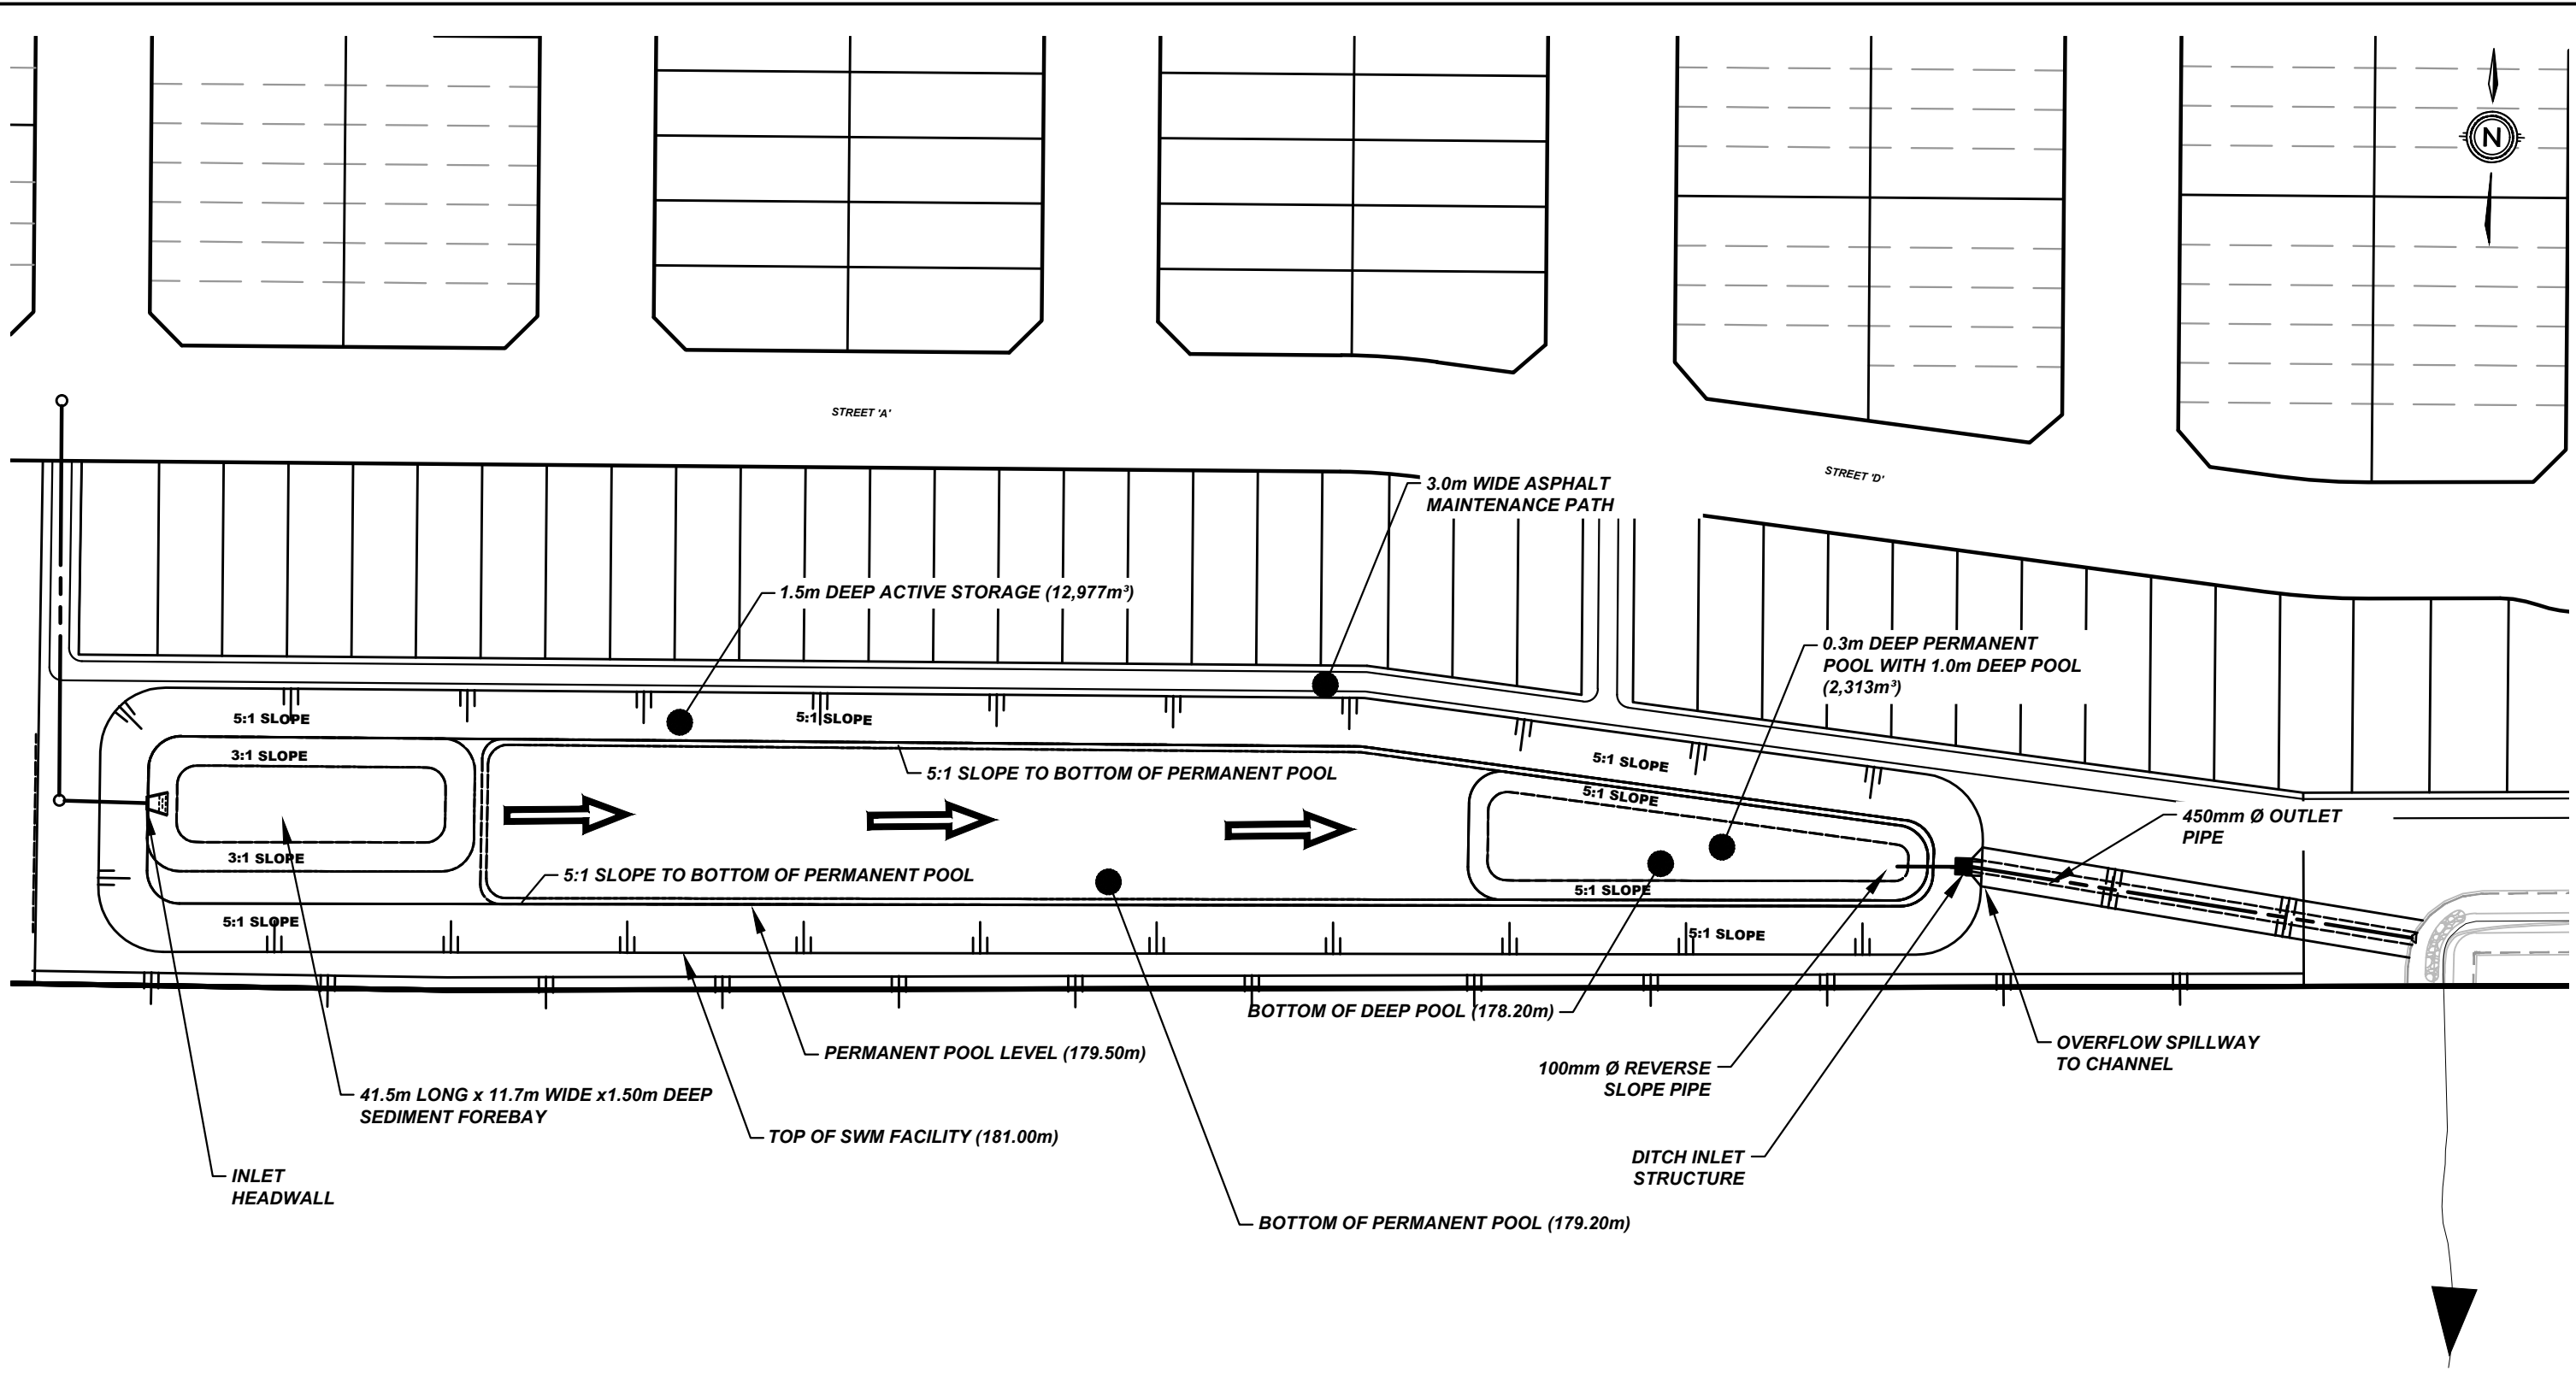

**UPPER CANADA  
CONSULTANTS**  
ENGINEERS / PLANNERS

**McLEOD MEADOWS  
PROPOSED SWM FACILITY**  
CITY OF NIAGARA FALLS

DATE	2024-11-04
SCALE	1:1000 m
REF No.	2054
DWG No.	FIGURE 4

## **6.0 SEDIMENT AND EROSION CONTROL**

Sediment and erosion controls are required during construction. The proposed extended detention facilities can be used for this purpose. Therefore, the proposed constructed wet pond facilities should be constructed prior to development of the remainder of the site. Runoff from the site can then be directed to the facility for sediment control during construction. Following construction, the accumulated sediments will be removed from the facilities and disposed at an appropriate dumping location.

The following additional erosion and sediment controls will also be implemented during construction:

- Install silt control fencing along the limits of construction where overland flows will flow beyond the limits of the development or into a downstream watercourse.
- Re-vegetate disturbed areas as soon as possible after grading works have been completed.
- Lot grading and siltation controls plans will be provided with sediment and erosion control measures to the appropriate agencies for approval during the final design stage.

## **7.0 STORMWATER MANAGEMENT FACILITY MAINTENANCE**

### **7.1 Wetland Facility**

Maintenance is a necessary and important aspect of urban stormwater quality and quantity measures such as constructed wetlands. Many pollutants (i.e. nutrients, metals, bacteria, etc.) bind to sediment and therefore removal of sediment on a scheduled basis is required.

The wetland for this development is subject to frequent wetting and deposition of sediments as a result of frequent low intensity storm events. The purpose of the wetland is to improve post development sediment and contaminant loadings by detaining the 'first flush' flow for a 24-hour period. For the initial operation period of the stormwater management facility, the required frequency of maintenance is not definitively known and many of the maintenance tasks will be performed on an 'as required' basis. For example, during the home construction phase of the development there will be a greater potential for increased maintenance frequency, which depends on the effectiveness of sediment and erosion control techniques employed.

Inspections of the wetland will indicate whether or not maintenance is required. Inspections should be made after every significant storm during the first two years of operation or until all development is completed to ensure the wet pond is functioning properly. This may translate into an average of six inspections per year. Once all building activity is finalized, inspections shall be performed annually. The following points should be addressed during inspections of the facility.

- a) Standing water above the inlet storm sewer invert a day or more after a storm may indicate a blockage in the reverse slope pipe or orifice. The blockage may be caused by trash or sediment and a visual inspection would be required to determine the cause.
- b) The vegetation around the wet pond should be inspected to ensure its function and aesthetics. Visual inspections will indicate whether replacement of plantings are required. A decline in vegetation habitat may indicate that other aspects of the constructed wetland are operating improperly, such as the detention times may be inadequate or excessive.
- c) The accumulation of sediment and debris at the wetland inlet sediment forebay or around the high-water line of the wetland should be inspected. This will indicate the need for sediment removal or debris clean up.
- d) The wetland has been created by excavating a detention area. The integrity of the embankments should be periodically checked to ensure that it remains watertight and the side slopes have not sloughed.

Grass cutting is a maintenance activity that is done solely for aesthetic purposes. It is recommended that grass cutting be eliminated. It should be noted that municipal by-laws may require regular grass maintenance for weed control.

Trash removal is an integral part of maintenance and an annual clean-up, usually in the spring, is a minimum requirement. After this, trash removal is performed as required basis on observation of trash build-up during inspections.

To ensure long term effectiveness, the sediment that accumulates in the forebay area should be removed periodically to ensure that sediment is not deposited throughout the facility. For sediment removal operations, typical grading/excavating equipment should be used to remove sediment from the inlet forebay and detention areas. Care should be taken to ensure that limited damage occurs to existing vegetation and habitat.

Generally, the sediment which is removed from the detention pond will not be contaminated to the point that it would be classified as hazardous waste. However, the sediment should be tested to determine the disposal options.



## 8.0 CONCLUSIONS AND RECOMMENDATIONS


Based on the findings of this study, the following conclusions are offered:

- Infiltration techniques are not suitable for this site as the primary control facility due to the low soil infiltration rates and the large drainage area for this development.
- Roof water leaders shall discharge to grade to enhance future infiltration levels.
- The proposed stormwater management wetland facility will provide stormwater quality and quantity controls for the approximately 19.28 hectare catchment area.
- Various lot level vegetative stormwater management practices can be implemented to enhance stormwater quality.
- This report was prepared in accordance with the provincial guidelines contained in “Stormwater Management Planning and Design Manual, March 2003”.

The above conclusions lead to the following recommendations:

- That the stormwater management criteria established in this report be accepted.
- That a stormwater management wetland facility be constructed to provide stormwater quality protection to MECP Enhanced Protection levels and quantity controls up to and including the 100 year design storm event, as outlined in this report.
- That additional lot level controls and vegetative stormwater management practices as described previously in this report be implemented.
- That sediment and erosion controls during construction as described in this report be implemented.

Prepared By:



Zach Barber, E.I.T.  
November 4, 2024



Reviewed By:



Brendan Kapteyn, P. Eng.  
November 4, 2024

**APPENDICES**

---

---

**APPENDIX A**  
**Stormwater Management Facility Calculations**

Upper Canada Consultants  
 3-30 Hannover Drive  
 St. Catharines, ON, L2W 1A3  
 PROJECT NAME: McLeod Meadows  
 PROJECT NO.: 2054

**PROPOSED CONSTRUCTED WETLAND CALCULATIONS**

Quality Requirements	Quality Orifice	Outlet Weir	Overflow Spillway	Outflow Pipe Orifice
Drainage Area (ha) = 19.28	Diameter (m) = 0.100	Perimeter Length (m) = 0.60	Length (m) = 8.00	Diameter (m) = 0.450
Enhanced (m3/ha) = 101	Cd = 0.65	Inlet Elevation (m) = 180.80	Slopes (X:1) = 5.00	Cd = 0.65
Perm Pool (m3/ha) = 61	Invert (m) = 179.50		Invert (m) = 180.85	Invert (m) = 179.50
Perm Pool Vol (m3) = 1,176		<b>Pond Drawdown Time Calculation (MOE, 2003)</b>		Obvert (m) = 179.95
Active Vol (m3) 771		25mm Event Water Surface Elevation (m) = 179.79		Top of Pipe (m) = 180.05
25mm MOE Volume = 2,017		MOE Equation 4.11 Drawdown Coefficient 'C2' = 3,044		
Water Level Elev. = 179.50 m		MOE Equation 4.11 Drawdown Coefficient 'C3' = 6,365		
		MOE Equation 4.11 Drawdown Time (h) = <b>92.2</b>		

Elevation	Increment Depth (m)	Active Depth (m)	Surface Area (m2)	Average Surface Area (m2)	Increment Volume (m3)	Permanent Volume (m3)	Active Volume (m3)	Quality Orifice (m3/s)	Ditch Inlet (m3/s)	Max Pipe Orifice (m3/s)	Overflow Spillway (m3/s)	Total Outflow (m3/s)	Average Discharge (m3/s)
178.20		-1.30	629				0						
Deep	0.50			744	372								
178.70		-0.80	859				372						
Deep	0.50			980	490								
<b>179.20</b>		<b>-0.30</b>	<b>1,100</b>				<b>862</b>						
								<b>Deep Pool Surface Area (m<sup>2</sup>) = 1,100</b> <b>Total Permanent Pool Surface Area (m<sup>2</sup>) = 5,053</b> <b>Deep Pool Area Coverage (25% MAX) = 22%</b>					
179.20		-0.30	4,617				862						
Perm	0.30			4,835	1,450								
<b>179.50</b>		0.00	5,053				2,313						
<b>179.50</b>		0.00	6,373				0	0.000	0.000	0.000	0.000	0.000	
Active	0.30			6,825	2,048								0.005
179.80		0.30	7,277				2,048	0.011	0.000	0.051	0.000	0.011	
Active	0.30			7,729	2,319								0.014
180.10		0.60	8,180				4,366	0.017	0.000	0.251	0.000	0.017	
Active	0.30			8,639	2,592								0.019
180.40		0.90	9,098				6,958	0.021	0.000	0.355	0.000	0.021	
Active	0.30			9,563	2,869								0.022
180.70		1.20	10,029				9,827	0.024	0.000	0.434	0.000	0.024	
Active	0.30			10,502	3,150								0.494
181.00		1.50	10,974				12,977	0.027	0.092	0.502	0.845	0.964	

**Notes**

1. Quality Orifice flow is the orifice controlling for the 24 hour detention period and uses an orifice formula.
2. Pipe Orifice flow is calculated using an orifice formula on the pipe from the ditch inlet to the outlet and uses the total head on the orifice.
3. Overflow Weir flow is calculated using a trapezoidal weir to convey outflow for less frequent storms through the embankment with an emergency spillway.
4. Total Outflow is calculated by adding the Overflow Spillway with the lowest of Quality Orifice plus Ditch Inlet or Max Pipe Orifice.

---

**APPENDIX B**  
**MIDUSS Output Files**

# Stormwater Management Plan McLeod Meadows , City of Niagara Falls

## B-1. Existing Conditions

```

Output File (4.7) EX.OUT      opened 2024-10-08
11:53 Units used are defined by G = 9.810
      24 144 10.000 are MAXDT MAXHYD & DTMIN values
Licensee: UPPER CANADA CONSULTANTS
35 COMMENT
4 line(s) of comment
  STORMWATER MANAGEMENT PLAN
  MCLEOD ROAD FRUITBELT
  CITY OF NIAGARA FALLS
  EXISTING CONDITIONS
14 START
35 1 1=Zero; 2=Define
  COMMENT
3 line(s) of comment
  *****
  5-YEAR STORM EVENT
  *****
2 STORM
  1 1=Chicago;2=Huff;3=User;4=Cdnlhr;5=Historic
719.500 Coefficient a
6.340 Constant b (min)
.769 Exponent c
.450 Fraction to peak r
240.000 Duration 0 240 min
      41.683 mm Total depth
3 IMPERVIOUS
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.015 Manning "n"
98.000 SCS Curve No or C
.100 Ia/S Coefficient
.518 Initial Abstraction
35 COMMENT
3 line(s) of comment
  *****
  Area EX1 AND A1 to Outlet A
  *****
4 CATCHMENT
  10.000 ID No.0 99999
  54.290 Area in hectares
  605.000 Length (PERV) metres
  1.000 Gradient (%)
  3.000 Per cent Impervious
  605.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
  1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.259 .000 .000 .000 c.m/s
.211 .875 .231 C perv/imperv/total
15 ADD RUNOFF
.259 .259 .000 .000 c.m/s
4 CATCHMENT
  1.000 ID No.0 99999
  15.890 Area in hectares
  325.500 Length (PERV) metres
  1.000 Gradient (%)
  1.530 Per cent Impervious
  325.500 Length (IMPERV)
.000 %Imp. with Zero Dpth
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
  1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.102 .259 .000 .000 c.m/s
.211 .869 .221 C perv/imperv/total
15 ADD RUNOFF
.102 .356 .000 .000 c.m/s
27 HYDROGRAPH DISPLAY
5 is # of Hyeto/Hydrograph chosen
Volume = .6690148E+04 c.m
14 START
35 1 1=Zero; 2=Define
  COMMENT
3 line(s) of comment
  *****
  Area B1 to Outlet B
  *****
4 CATCHMENT
  2.000 ID No.0 99999
  5.720 Area in hectares
  195.300 Length (PERV) metres
  1.000 Gradient (%)
  1.000 Per cent Impervious
  195.300 Length (IMPERV)
.000 %Imp. with Zero Dpth
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
  1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.047 .000 .000 .000 c.m/s
.211 .871 .218 C perv/imperv/total
15 ADD RUNOFF
.047 .047 .000 .000 c.m/s
27 HYDROGRAPH DISPLAY
5 is # of Hyeto/Hydrograph chosen
Volume = .5186454E+03 c.m
14 START
35 1 1=Zero; 2=Define
  COMMENT
3 line(s) of comment
  *****
Area C1 to Outlet C
*****
4 CATCHMENT
  3.000 ID No.0 99999
  2.290 Area in hectares
  123.600 Length (PERV) metres
  1.000 Gradient (%)
  4.410 Per cent Impervious
  123.600 Length (IMPERV)
.000 %Imp. with Zero Dpth
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
  1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.024 .000 .000 .000 c.m/s
.211 .856 .239 C perv/imperv/total
15 ADD RUNOFF
.024 .024 .000 .000 c.m/s
27 HYDROGRAPH DISPLAY
5 is # of Hyeto/Hydrograph chosen
Volume = .2285447E+03 c.m
14 START
35 1 1=Zero; 2=Define
  COMMENT
3 line(s) of comment
  *****
  100-YEAR STORM EVENT
  *****
2 STORM
  1 1=Chicago;2=Huff;3=User;4=Cdnlhr;5=Historic
1264.600 Coefficient a
7.720 Constant b (min)
.781 Exponent c
.450 Fraction to peak r
240.000 Duration 0 240 min
      68.280 mm Total depth
3 IMPERVIOUS
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.015 Manning "n"
98.000 SCS Curve No or C
.100 Ia/S Coefficient
.518 Initial Abstraction
35 COMMENT
3 line(s) of comment
  *****
  Area EX1 AND A1 to Outlet A
  *****
4 CATCHMENT
  10.000 ID No.0 99999
  54.290 Area in hectares
  605.000 Length (PERV) metres
  1.000 Gradient (%)
  3.000 Per cent Impervious
  605.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
  1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.998 .000 .000 .000 c.m/s
.347 .918 .364 C perv/imperv/total
15 ADD RUNOFF
.998 .998 .000 .000 c.m/s
4 CATCHMENT
  1.000 ID No.0 99999
  15.890 Area in hectares
  325.500 Length (PERV) metres
  1.000 Gradient (%)
  1.530 Per cent Impervious
  325.500 Length (IMPERV)
.000 %Imp. with Zero Dpth
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
  1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.399 .998 .000 .000 c.m/s
.347 .920 .356 C perv/imperv/total
15 ADD RUNOFF
.399 1.378 .000 .000 c.m/s
27 HYDROGRAPH DISPLAY
5 is # of Hyeto/Hydrograph chosen
Volume = .1735919E+05 c.m
14 START
35 1 1=Zero; 2=Define
  COMMENT
3 line(s) of comment
  *****
  Area B1 to Outlet B
  *****
4 CATCHMENT
  2.000 ID No.0 99999
  5.720 Area in hectares
  195.300 Length (PERV) metres
  1.000 Gradient (%)
  1.000 Per cent Impervious
  195.300 Length (IMPERV)
.000 %Imp. with Zero Dpth
  1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
  1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv

```

# Stormwater Management Plan

## McLeod Meadows , City of Niagara Falls

---

```
.182      .000      .000      .000 c.m/s
.347      .901      .353      C perv/imperv/total
15  ADD RUNOFF      .182      .182      .000      .000 c.m/s
27  HYDROGRAPH DISPLAY
5    is # of Hyeto/Hydrograph chosen
Volume = .1377275E+04 c.m
14  START
1    1=Zero; 2=Define
35  COMMENT
3    line(s) of comment
*****
Area C1 to Outlet C
*****
4  CATCHMENT
3.000    ID No. 6 99999
2.290    Area in hectares
123.600  Length (PERV) metres
1.000    Gradient (%)
4.410    Per cent Impervious
123.600  Length (IMPERV)
.000     %Imp. with Zero Dpth
1        Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250     Manning "n"
74.000   SCS Curve No or C
.100     Ia/S Coefficient
8.924    Initial Abstraction
1        Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.091     .000     .000     .000 c.m/s
.347     .909     .372     C perv/imperv/total
15  ADD RUNOFF      .091     .091     .000     .000 c.m/s
27  HYDROGRAPH DISPLAY
5    is # of Hyeto/Hydrograph chosen
Volume = .5813171E+03 c.m
20  MANUAL
```

# Stormwater Management Plan McLeod Meadows, City of Niagara Falls

## B-2. Future Conditions without SWM

Output File (4.7) FUT.OUT opened 2024-11-04 9:13  
 Units used are defined by G = 9.810  
 24 144 10.000 are MAXDT MAXHYD & DTMIN values  
 Licensee: UPPER CANADA CONSULTANTS  
 35 COMMENT  
 4 1 line(s) of comment  
 STORMWATER MANAGEMENT PLAN  
 MCLEOD ROAD FRUITBELT  
 CITY OF NIAGARA FALLS  
 FUT CONDITIONS  
 35 COMMENT  
 3 1 line(s) of comment  
 \*\*\*\*\*  
 5-YEAR STORM EVENT  
 \*\*\*\*\*  
 2 STORM  
 1 1=Chicago;2=Huff;3=User;4=Cdnlhr;5=Historic  
 719.500 Coefficient a  
 6.340 Constant b (min)  
 .769 Exponent c  
 .450 Fraction to peak r  
 240.000 Duration ó 240 min  
 41.683 mm Total depth  
 3 IMPERVIOUS  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .015 Manning "n"  
 98.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 .518 Initial Abstraction  
 35 COMMENT  
 3 1 line(s) of comment  
 \*\*\*\*\*  
 Uncontrolled Area - C10 to Outlet C  
 \*\*\*\*\*  
 4 CATCHMENT  
 10.000 ID No.ó 99999  
 .840 Area in hectares  
 123.600 Length (PERV) metres  
 1.000 Gradient (%)  
 18.000 Per cent Impervious  
 123.600 Length (IMPERV)  
 .000 %Imp. with Zero Dpth  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .250 Manning "n"  
 74.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 8.924 Initial Abstraction  
 1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv  
 .024 .000 .000 .000 c.m/s  
 .211 .856 .327 C perv/imperv/total  
 15 ADD RUNOFF  
 .024 .024 .000 .000 c.m/s  
 27 HYDROGRAPH DISPLAY  
 5 is # of Hyeto/Hydrograph chosen  
 Volume = .1145267E+03 c.m  
 14 START  
 1 1=Zero; 2=Define  
 35 COMMENT  
 3 1 line(s) of comment  
 \*\*\*\*\*  
 Uncontrolled Areas  
 \*\*\*\*\*  
 4 CATCHMENT  
 1.000 ID No.ó 99999  
 55.610 Area in hectares  
 610.000 Length (PERV) metres  
 1.000 Gradient (%)  
 4.000 Per cent Impervious  
 610.000 Length (IMPERV)  
 .000 %Imp. with Zero Dpth  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .250 Manning "n"  
 74.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 8.924 Initial Abstraction  
 1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv  
 .304 .000 .000 .000 c.m/s  
 .211 .875 .238 C perv/imperv/total  
 15 ADD RUNOFF  
 .304 .304 .000 .000 c.m/s  
 4 CATCHMENT  
 10.000 ID No.ó 99999  
 2.460 Area in hectares  
 130.000 Length (PERV) metres  
 1.000 Gradient (%)  
 10.000 Per cent Impervious  
 130.000 Length (IMPERV)  
 .000 %Imp. with Zero Dpth  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .250 Manning "n"  
 74.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 8.924 Initial Abstraction  
 1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv  
 .042 .304 .000 .000 c.m/s  
 .211 .854 .275 C perv/imperv/total  
 15 ADD RUNOFF  
 .042 .346 .000 .000 c.m/s  
 9 ROUTE  
 .000 Conduit Length  
 .000 No Conduit defined  
 .000 Zero lag  
 .000 Beta weighting factor  
 .000 Routing timestep  
 0 No. of sub-reaches  
 .042 .346 .346 .000 c.m/s  
 17 COMBINE  
 1 Junction Node No.  
 .042 .346 .346 .346 c.m/s  
 14 START

1 1=Zero; 2=Define  
 35 COMMENT  
 3 1 line(s) of comment  
 \*\*\*\*\*  
 Area All  
 \*\*\*\*\*  
 4 CATCHMENT  
 11.000 ID No.ó 99999  
 16.320 Area in hectares  
 330.000 Length (PERV) metres  
 1.000 Gradient (%)  
 60.000 Per cent Impervious  
 330.000 Length (IMPERV)  
 .000 %Imp. with Zero Dpth  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .250 Manning "n"  
 74.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 8.924 Initial Abstraction  
 1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv  
 .1551 .000 .346 .346 c.m/s  
 .211 .868 .605 C perv/imperv/total  
 15 ADD RUNOFF  
 1.551 1.551 .346 .346 c.m/s  
 4 CATCHMENT  
 12.000 ID No.ó 99999  
 2.960 Area in hectares  
 140.000 Length (PERV) metres  
 1.000 Gradient (%)  
 10.000 Per cent Impervious  
 140.000 Length (IMPERV)  
 .000 %Imp. with Zero Dpth  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .250 Manning "n"  
 74.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 8.924 Initial Abstraction  
 1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv  
 .050 1.551 .346 .346 c.m/s  
 .211 .856 .275 C perv/imperv/total  
 15 ADD RUNOFF  
 .050 1.601 .346 .346 c.m/s  
 9 ROUTE  
 .000 Conduit Length  
 .000 No Conduit defined  
 .000 Zero lag  
 .000 Beta weighting factor  
 .000 Routing timestep  
 0 No. of sub-reaches  
 .050 1.601 1.601 .346 c.m/s  
 17 COMBINE  
 1 Junction Node No.  
 .050 1.601 1.601 1.947 c.m/s  
 35 COMMENT  
 3 1 line(s) of comment  
 \*\*\*\*\*  
 Flow at Outlet A  
 \*\*\*\*\*  
 18 CONFLUENCE  
 1 Junction Node No.  
 .050 1.947 1.601 .000 c.m/s  
 27 HYDROGRAPH DISPLAY  
 5 is # of Hyeto/Hydrograph chosen  
 Volume = .1024620E+05 c.m  
 14 START  
 1 1=Zero; 2=Define  
 35 COMMENT  
 3 1 line(s) of comment  
 \*\*\*\*\*  
 100-YEAR STORM EVENT  
 \*\*\*\*\*  
 2 STORM  
 1 1=Chicago;2=Huff;3=User;4=Cdnlhr;5=Historic  
 1264.600 Coefficient a  
 7.720 Constant b (min)  
 .781 Exponent c  
 .450 Fraction to peak r  
 240.000 Duration ó 240 min  
 68.280 mm Total depth  
 3 IMPERVIOUS  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .015 Manning "n"  
 98.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 .518 Initial Abstraction  
 35 COMMENT  
 3 1 line(s) of comment  
 \*\*\*\*\*  
 Uncontrolled Area - C10 to Outlet C  
 \*\*\*\*\*  
 4 CATCHMENT  
 10.000 ID No.ó 99999  
 .840 Area in hectares  
 123.600 Length (PERV) metres  
 1.000 Gradient (%)  
 18.000 Per cent Impervious  
 123.600 Length (IMPERV)  
 .000 %Imp. with Zero Dpth  
 1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat  
 .250 Manning "n"  
 74.000 SCS Curve No or C  
 .100 Ia/S Coefficient  
 8.924 Initial Abstraction  
 1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv  
 .046 .000 1.601 .000 c.m/s  
 .347 .909 .448 C perv/imperv/total  
 15 ADD RUNOFF  
 .046 .046 1.601 .000 c.m/s  
 27 HYDROGRAPH DISPLAY  
 5 is # of Hyeto/Hydrograph chosen



# Stormwater Management Plan

## McLeod Meadows , City of Niagara Falls

```

14 Volume = .2570677E+03 c.m
START
35 1 l=Zero; 2=Define
COMMENT
3 line(s) of comment
*****
Uncontrolled Areas
*****
4 CATCHMENT
1.000 ID No.6 99999
55.610 Area in hectares
610.000 Length (PERV) metres
1.000 Gradient (%)
4.000 Per cent Impervious
610.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
1.020 .000 1.601 .000 c.m/s
.347 .918 .370 C perv/imperv/total
15 ADD RUNOFF
1.020 1.020 1.601 .000 c.m/s
4 CATCHMENT
10.000 ID No.6 99999
2.460 Area in hectares
130.000 Length (PERV) metres
1.000 Gradient (%)
10.000 Per cent Impervious
130.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.099 1.020 1.601 .000 c.m/s
.347 .909 .403 C perv/imperv/total
15 ADD RUNOFF
.099 1.071 1.601 .000 c.m/s
9 ROUTE
.000 Conduit Length
.000 No Conduit defined
.000 Zero lag
.000 Beta weighting factor
.000 Routing timestep
0 No. of sub-reaches
.099 1.071 1.071 .000 c.m/s
17 COMBINE
1 Junction Node No.
.099 1.071 1.071 1.071 c.m/s
14 START
1 l=Zero; 2=Define
35 COMMENT
3 line(s) of comment
*****
Area All
*****
4 CATCHMENT
11.000 ID No.6 99999
16.320 Area in hectares
330.000 Length (PERV) metres
1.000 Gradient (%)
60.000 Per cent Impervious
330.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
2.569 .000 1.071 1.071 c.m/s
.347 .920 .691 C perv/imperv/total
15 ADD RUNOFF
2.569 2.569 1.071 1.071 c.m/s
4 CATCHMENT
12.000 ID No.6 99999
2.960 Area in hectares
140.000 Length (PERV) metres
1.000 Gradient (%)
10.000 Per cent Impervious
140.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.116 2.569 1.071 1.071 c.m/s
.347 .907 .403 C perv/imperv/total
15 ADD RUNOFF
.116 2.677 1.071 1.071 c.m/s
9 ROUTE
.000 Conduit Length
.000 No Conduit defined
.000 Zero lag
.000 Beta weighting factor
.000 Routing timestep
0 No. of sub-reaches
.116 2.677 2.677 1.071 c.m/s
17 COMBINE
1 Junction Node No.
.116 2.677 2.677 3.499 c.m/s
35 COMMENT
3 line(s) of comment
*****
Flow at Outlet A

```

# Stormwater Management Plan McLeod Meadows , City of Niagara Falls

## B-3. Future Conditions with SWM

```

Output File (4.7) SWM.OUT      opened 2024-11-04   9:14
Units used are defined by G =   9.810
24 144 10.000
Licensee: UPPER CANADA CONSULTANTS
COMMENT
35 4 line(s) of comment
STORMWATER MANAGEMENT PLAN
MCLEOD ROAD FRUITBELT
CITY OF NIAGARA FALLS
SWM CONDITIONS
COMMENT
35 3 line(s) of comment
*****
25mm STORM EVENT
*****
2 STORM
1 1=Chicago;2=Huff;3=User;4=Cdnlhr;5=Historic
512.000 Coefficient a
6.000 Constant b (min)
.800 Exponent c
.450 Fraction to peak r
240.000 Duration ó 240 min
25.035 mm Total depth
3 IMPERVIOUS
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.015 Manning "n"
98.000 SCS Curve No or C
.100 Ia/S Coefficient
.518 Initial Abstraction
COMMENT
35 3 line(s) of comment
*****
Area All
*****
4 CATCHMENT
11.000 ID No.ó 99999
16.320 Area in hectares
330.000 Length (PERV) metres
1.000 Gradient (%)
60.000 Per cent Impervious
330.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.879 .000 .000 .000 c.m/s
15 ADD RUNOFF .098 .805 .522 C perv/imperv/total
.879 .879 .000 .000 c.m/s
4 CATCHMENT
12.000 ID No.ó 99999
2.960 Area in hectares
140.000 Length (PERV) metres
1.000 Gradient (%)
10.000 Per cent Impervious
140.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.028 .879 .000 .000 c.m/s
.098 .803 .169 C perv/imperv/total
15 ADD RUNOFF .028 .907 .000 .000 c.m/s
10 POND
6 Depth - Discharge - Volume sets
179.500 .000 .0
179.800 .0110 2048.0
180.100 .0170 4366.0
180.400 .0210 6958.0
180.700 .0240 9827.0
181.000 .964 12977.0
Peak Outflow = .011 c.m/s
Maximum Depth = 179.795 metres
Maximum Storage = 2017. c.m
.028 .907 .011 .000 c.m/s
14 START
1 1=Zero; 2=Define
COMMENT
35 3 line(s) of comment
*****
5-YEAR STORM EVENT
*****
2 STORM
1 1=Chicago;2=Huff;3=User;4=Cdnlhr;5=Historic
719.500 Coefficient a
6.340 Constant b (min)
.769 Exponent c
.450 Fraction to peak r
240.000 Duration ó 240 min
41.683 mm Total depth
3 IMPERVIOUS
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.015 Manning "n"
98.000 SCS Curve No or C
.100 Ia/S Coefficient
.518 Initial Abstraction
COMMENT
35 3 line(s) of comment
*****
Uncontrolled Area - C10 to Outlet C
*****
4 CATCHMENT
10.000 ID No.ó 99999
.840 Area in hectares
123.600 Length (PERV) metres
1.000 Gradient (%)
18.000 Per cent Impervious
123.600 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.024 .000 .011 .000 c.m/s
.211 .856 .327 C perv/imperv/total
15 ADD RUNOFF .024 .024 .011 .000 c.m/s
14 START
1 1=Zero; 2=Define
COMMENT
35 3 line(s) of comment
*****
Uncontrolled Areas
*****
4 CATCHMENT
1.000 ID No.ó 99999
55.610 Area in hectares
610.000 Length (PERV) metres
1.000 Gradient (%)
4.000 Per cent Impervious
610.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.304 .000 .011 .000 c.m/s
.211 .875 .238 C perv/imperv/total
15 ADD RUNOFF .304 .304 .011 .000 c.m/s
4 CATCHMENT
10.000 ID No.ó 99999
2.460 Area in hectares
130.000 Length (PERV) metres
1.000 Gradient (%)
10.000 Per cent Impervious
130.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
.042 .304 .011 .000 c.m/s
.211 .854 .275 C perv/imperv/total
15 ADD RUNOFF .042 .346 .011 .000 c.m/s
9 ROUTE
.000 Conduit Length
.000 No Conduit defined
.000 Zero lag
.000 Beta weighting factor
.000 Routing timestep
0 No. of sub-reaches
.042 .346 .346 .000 c.m/s
17 COMBINE
1 Junction Node No.
.042 .346 .346 .346 c.m/s
14 START
1 1=Zero; 2=Define
COMMENT
35 3 line(s) of comment
*****
Area All
*****
4 CATCHMENT
11.000 ID No.ó 99999
16.320 Area in hectares
330.000 Length (PERV) metres
1.000 Gradient (%)
60.000 Per cent Impervious
330.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin. Reserv
1.551 .000 .346 .346 c.m/s
.211 .868 .605 C perv/imperv/total
15 ADD RUNOFF 1.551 1.551 .346 .346 c.m/s
4 CATCHMENT
12.000 ID No.ó 99999
2.960 Area in hectares
140.000 Length (PERV) metres
1.000 Gradient (%)
10.000 Per cent Impervious
140.000 Length (IMPERV)
.000 %Imp. with Zero Dpth
1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat
.250 Manning "n"
74.000 SCS Curve No or C
.100 Ia/S Coefficient
8.924 Initial Abstraction
1 Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin.

```

# Stormwater Management Plan

## McLeod Meadows , City of Niagara Falls

Reserv	.050	1.551	.346	.346 c.m/s	15	ADD RUNOFF	.099	1.071	.016	.000 c.m/s
	.211	.856	.275	C perv/imperv/total	9	ROUTE	.000			
15	ADD RUNOFF	.050	1.601	.346	.346 c.m/s		Conduit Length	.000		
10	POND						No Conduit defined	.000		
	6 Depth - Discharge - Volume sets						Zero lag	.000		
	179.500	.000	.0				Beta weighting factor	.000		
	179.800	.0110	2048.0				Routing timestep	.000		
	180.100	.0170	4366.0				No. of sub-reaches	0		
	180.400	.0210	6958.0					.099	1.071	.000 c.m/s
	180.700	.0240	9827.0			17	COMBINE			
	181.000	.964	12977.0				1 Junction Node No.	.099	1.071	1.071 c.m/s
	Peak Outflow =	.016	c.m/s			14	START	1	1=Zero; 2=Define	
	Maximum Depth =	180.062	metres			35	COMMENT	3	line(s) of comment	
	Maximum Storage =	4075.	c.m				*****			
17	COMBINE	.050	1.601	.016	.346 c.m/s		Area All	*****		
	1 Junction Node No.	.050	1.601	.016	.353 c.m/s	35	CATCHMENT			
35	COMMENT						11.000	ID No.6 99999		
	3 line(s) of comment						16.320	Area in hectares		
	*****						330.000	Length (PERV) metres		
	Flow at Outlet A						1.000	Gradient (%)		
	*****						60.000	Per cent Impervious		
18	CONFLUENCE						330.000	Length (IMPERV)		
	1 Junction Node No.	.050	.353	.016	.000 c.m/s		.000	%Imp. with Zero Dpth		
14	START						1	Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat		
	1 1=Zero; 2=Define						.250	Manning "n"		
35	COMMENT						74.000	SCS Curve No or C		
	3 line(s) of comment						.100	Ia/S Coefficient		
	*****						8.924	Initial Abstraction		
	100-YEAR STORM EVENT						1	Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin.		
	*****									
2	STORM					Reserv	2.569	.000	1.071	1.071 c.m/s
	1 1=Chicago;2=Huff;3=User;4=Odnlhr;5=Historic						.347	.920	.691	C perv/imperv/total
1264.600	Coefficient a					15	ADD RUNOFF	2.569	2.569	1.071
7.720	Constant b (min)						4	CATCHMENT		
.781	Exponent c						12.000	ID No.6 99999		
.450	Fraction to peak r						2.960	Area in hectares		
240.000	Duration 6 240 min						140.000	Length (PERV) metres		
	68.280 mm Total depth						1.000	Gradient (%)		
3	IMPERVIOUS						10.000	Per cent Impervious		
	1 Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat						140.000	Length (IMPERV)		
	.015 Manning "n"						.000	%Imp. with Zero Dpth		
98.000	SCS Curve No or C						1	Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat		
.100	Ia/S Coefficient						.250	Manning "n"		
.518	Initial Abstraction						74.000	SCS Curve No or C		
35	COMMENT						.100	Ia/S Coefficient		
	3 line(s) of comment						8.924	Initial Abstraction		
	*****						1	Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin.		
	Uncontrolled Area - C10 to Outlet C									
	*****									
4	CATCHMENT					Reserv	.116	2.569	1.071	1.071 c.m/s
	10.000	ID No.6 99999					.347	.907	.403	C perv/imperv/total
	.840	Area in hectares				15	ADD RUNOFF	.116	2.677	1.071
	123.600	Length (PERV) metres					10	POND		
	1.000	Gradient (%)						6 Depth - Discharge - Volume sets		
	18.000	Per cent Impervious						179.500	.000	.0
	123.600	Length (IMPERV)						179.800	.0110	2048.0
	.000	%Imp. with Zero Dpth						180.100	.0170	4366.0
	1	Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat						180.400	.0210	6958.0
	.250	Manning "n"						180.700	.0240	9827.0
	74.000	SCS Curve No or C						181.000	.964	12977.0
	.100	Ia/S Coefficient						Peak Outflow =	.022	c.m/s
	8.924	Initial Abstraction						Maximum Depth =	180.511	metres
	1	Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin.	Reserv					Maximum Storage =	8023.	c.m
	.046	.000	.016	.000 c.m/s					.116	2.677
	.347	.909	.448	C perv/imperv/total						.022
15	ADD RUNOFF	.046	.046	.016	.000 c.m/s	17	COMBINE			
	START						1 Junction Node No.	.116	2.677	.022
14	START						1	1=Zero; 2=Define		1.091 c.m/s
	1 1=Zero; 2=Define						35	COMMENT		
35	COMMENT							3 line(s) of comment		
	3 line(s) of comment							*****		
	*****							Flow at Outlet A		
	Uncontrolled Areas							*****		
	*****							18	CONFLUENCE	
4	CATCHMENT							1 Junction Node No.	.116	1.091
	1.000	ID No.6 99999							.022	.000 c.m/s
	55.610	Area in hectares								
	610.000	Length (PERV) metres								
	1.000	Gradient (%)								
	4.000	Per cent Impervious								
	610.000	Length (IMPERV)								
	.000	%Imp. with Zero Dpth								
	1	Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat								
	.250	Manning "n"								
	74.000	SCS Curve No or C								
	.100	Ia/S Coefficient								
	8.924	Initial Abstraction								
	1	Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin.	Reserv							
	1.020	.000	.016	.000 c.m/s						
	.347	.918	.370	C perv/imperv/total						
15	ADD RUNOFF	1.020	1.020	.016	.000 c.m/s					
4	CATCHMENT									
	10.000	ID No.6 99999								
	2.460	Area in hectares								
	130.000	Length (PERV) metres								
	1.000	Gradient (%)								
	10.000	Per cent Impervious								
	130.000	Length (IMPERV)								
	.000	%Imp. with Zero Dpth								
	1	Option 1=SCS CN/C; 2=Horton; 3=Green-Ampt; 4=Repeat								
	.250	Manning "n"								
	74.000	SCS Curve No or C								
	.100	Ia/S Coefficient								
	8.924	Initial Abstraction								
	1	Option 1=Trianglr; 2=Rectanglr; 3=SWM HYD; 4=Lin.	Reserv							
	.099	1.020	.016	.000 c.m/s						
	.347	.909	.403	C perv/imperv/total						