
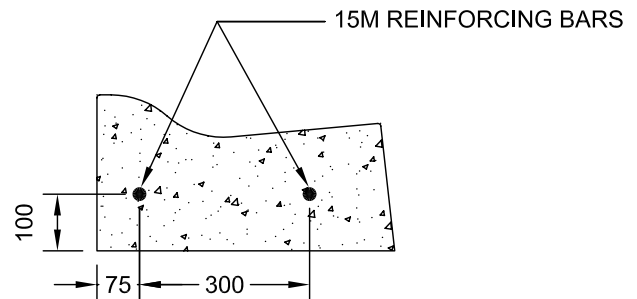


NOTE:
 1. PROPOSED EPOXY COATED 15M REINFORCING BAR TO BE DRILLED 200mm INTO EXISTING CURB AND EXTEND 200mm INTO PROPOSED CURB.
 2. DIMENSIONS IN mm UNLESS NOTED OTHERWISE.

CONCRETE BARRIER CURB

CONCRETE SEMI-MOUNTABLE CURB

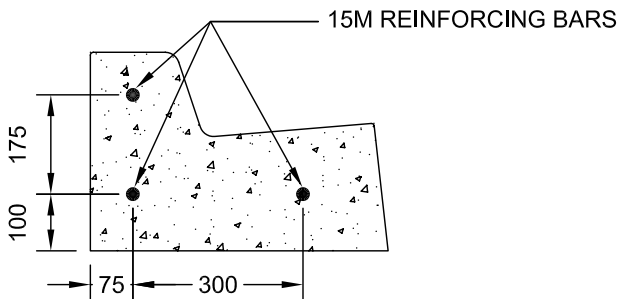

CITY OF NIAGARA FALLS
 MUNICIPAL WORKS

CONCRETE CURB RESTORATION
 CATCHBASIN AND CURB & GUTTER DETAIL

SCALE N.T.S.

DATE APRIL 2008

DWG. NO.

NFS-B03

REV.

0